

**SAMSUNG**

# **EHS**

# **Technical**

# **Data Book**

**EHS tank integrated Hydro Unit  
for Europe  
(Mono, R32, 50Hz, HP)**



Model : Outdoor unit (AE\*\*\*RXYD\*G/EU)  
Hydro unit (AE\*\*\*RNWM\*G/EU)

# History

---

Version	Modification	Date	Remark
Ver.1.0	Released EHS tank integrated Hydro Unit for Europe TDB (Mono, R32, 50Hz, HP), 1st Version)	19. 02. 01	
Ver.1.1	Released EHS tank integrated Hydro Unit for Europe TDB (Mono, R32, 50Hz, HP)	19. 05. 07	
Ver.1.2	Modified the Operation range	19. 11. 14	

# Nomenclature

## Outdoor Unit

### Model Name

<b>AE</b>	<b>050</b>	<b>R</b>	<b>X</b>	<b>Y</b>	<b>D</b>	<b>E</b>	<b>G</b>	/	<b>EU</b>
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)		Buyer

#### (1) Classification

<b>AC</b>	CAC
<b>AM</b>	DVM
<b>AJ</b>	FJM (Free Joint Multi)
<b>AE</b>	EHS

#### (2) Capacity

X 1/10 kW (3 digits)
----------------------

#### (3) Version

<b>R</b>	2019
----------	------

#### (4) Product Type

<b>S</b>	SET (NASA)
<b>N</b>	Indoor Unit (NASA)
<b>X</b>	Outdoor Unit (NASA)
<b>A</b>	SET (Non NASA)
<b>B</b>	Indoor Unit (Non NASA)
<b>C</b>	Outdoor Unit (Non NASA)

#### (5) Feature 1

<b>E</b>	Split
<b>T</b>	TDM
<b>Y</b>	MONO

#### (6) Feature 2

<b>D</b>	Deluxe
<b>P</b>	Premium

#### (7) Rating Voltage

<b>A</b>	115V, 60hz, 1Φ
<b>B</b>	220V, 60Hz, 1Φ
<b>C</b>	208~230V, 60Hz, 1Φ
<b>D</b>	200~220V, 50Hz, 1Φ
<b>E</b>	220~240V, 50Hz, 1Φ
<b>F</b>	208~230V, 60Hz, 3Φ
<b>G</b>	380~415V, 50Hz, 3Φ

#### (8) Mode

<b>G</b>	Heat Pump (R32)
----------	-----------------

# Nomenclature

## Tank integrated hydro unit

### Model Name

<b>AE</b>	<b>200</b>	<b>R</b>	<b>N</b>	<b>W</b>	<b>M</b>	<b>E</b>	<b>G</b>	/	<b>EU</b>
(1)	(2)	(3)	(4)	(5)	(6)	(7)	(8)		Buyer

#### (1) Classification

<b>AC</b>	CAC
<b>AM</b>	DVM
<b>AJ</b>	FJM (Free Joint Multi)
<b>AE</b>	EHS

#### (2) Capacity

x Liter (3 digits)
--------------------

#### (3) Version

<b>R</b>	2019
----------	------

#### (4) Product Type

<b>S</b>	SET (NASA)
<b>N</b>	Indoor Unit (NASA)
<b>X</b>	Outdoor Unit (NASA)
<b>A</b>	SET (Non NASA)
<b>B</b>	Indoor Unit (Non NASA)
<b>C</b>	Outdoor Unit (Non NASA)

#### (5) Product Notation

<b>W</b>	Tank integrated hydro unit
----------	----------------------------

#### (6) Feature

<b>S</b>	Split
<b>M</b>	Mono

#### (7) Rating Voltage

<b>A</b>	115V, 60hz, 1Φ
<b>B</b>	220V, 60Hz, 1Φ
<b>C</b>	208~230V, 60Hz, 1Φ
<b>D</b>	200~220V, 50Hz, 1Φ
<b>E</b>	220~240V, 50Hz, 1Φ
<b>F</b>	208~230V, 60Hz, 3Φ
<b>G</b>	380~415V, 50Hz, 3Φ

#### (8) Mode

<b>G</b>	Heat Pump (R32)
----------	-----------------

# Features & Benefits

## Overview



**World-class SCOP**  
**The Highest Grade A+++**

R410A    R32 (All model)

**Powerful Heating**  
**90% at the Low Ambient**

※ 90% of heating performance  
 at -10°C of ambient Temp.

**Tank integrated Hydro Unit**

**High Temp Water Outlet**

**Up to 65°C**  
 ※ at winter season

15°C → 55°C → 65°C

**Wide Range of Operation**

**Down to -25°C**  
 ※ At winter season

-25°C

**Smart Wi-Fi**  
**Control Anywhere, Anytime**

※ Optional Kit

**R32 Line Up**

**The R32 4kW~9kW Split**  
**5kW ~ 16kW Mono**

## World-class Seasonal Coefficient of Performance

- Acquired A+++ Energy grade (All R32 models)




R410A

R32 (All Split & Mono, A7W35 condition)

A+++

P-designh value up

## Minimum Energy Performance Standard (EU)

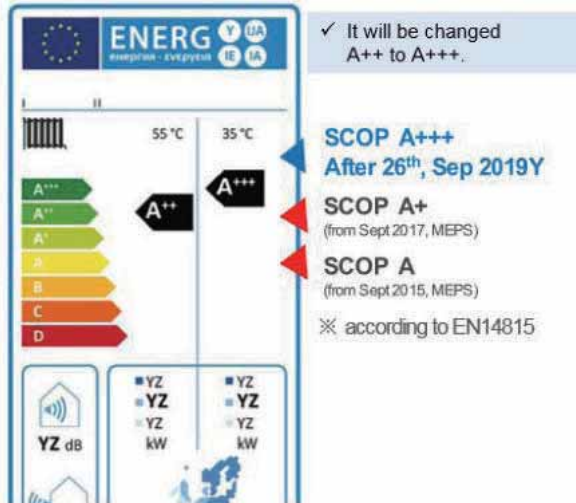

ENERG

It will be changed A++ to A+++.

SCOP A+++ After 26<sup>th</sup>, Sep 2019Y

SCOP A+ (from Sept 2017, MEPS)


SCOP A (from Sept 2015, MEPS)

※ according to EN14815

# Features & Benefits

## Higher Heating Capacity at Low Temperature

- The new models provide comfort with 90% of heating performance at -10°C of ambient temperature.

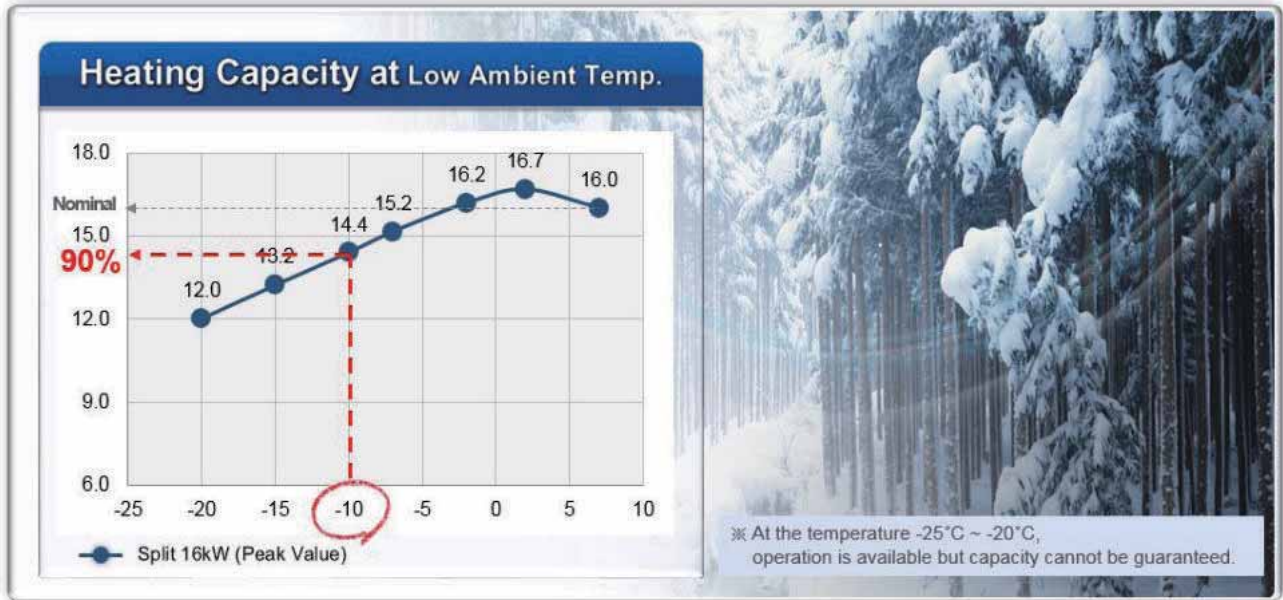

## Control AC Anywhere, Anytime (Optional)

- Can control your air conditioner with your smart phone.
- Can easily turn it on/off outside the house.






# Features & Benefits

## 2-wire line for new graphic type wired remote controller

- More simple & convenient
- Communication response time : Max. 24sec → Max. 1sec

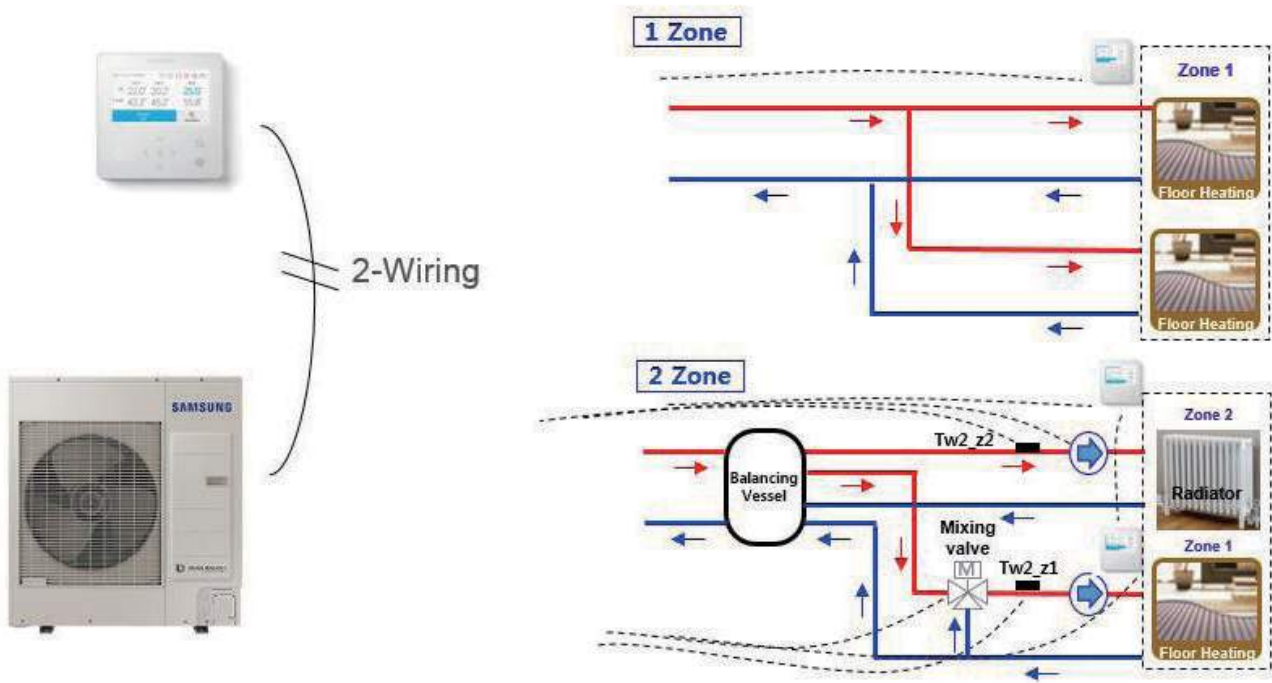

# Contents

---

<b>1. Line-up</b>	<b>9</b>
1-1. Outdoor Units	9
1-2. Tank integrated hydro unit	9
<b>2. Outdoor Units</b>	<b>10</b>
2-1. Specifications	10
2-2. Electrical characteristics	14
2-3. Dimensional drawing	15
2-4. Electrical wiring diagram	18
2-5. Sound data	21
2-6. Operation range	26
2-7. Piping diagram	27
2-8. Capacity table	28
2-9. Silent mode corrections	31
<b>3. Tank integrated hydro unit</b>	<b>32</b>
3-1. Specifications	32
3-2. Dimensional drawing	38
3-3. Electrical wiring diagram	39
3-4. Sound data	41
3-5. Piping diagram	48
<b>4. Installation</b>	<b>49</b>
Tank integrated hydro unit	49
Outdoor Unit	56
Wiring	58



# 1. Line-up

## 1-1. Outdoor Units

Capacity		5.0 kW	8.0 kW	12.0 / 16.0 kW
Image				
Model	1 phase	AE050RXYDEG/EU	AE080RXYDEG/EU	AE120RXYDEG/EU AE160RXYDEG/EU
	3 phase	-	AE080RXYDGG/EU	AE120RXYDGG/EU AE160RXYDGG/EU

## 1-2. Tank integrated hydro unit

Type \ Capacity	200 L	260 L
Model	AE200RNWMEG/EU	AE260RNWM*G/EU
Hydro unit		

# 2. Outdoor Units

## 2-1. Specifications

Model Name		Indoor Unit			AE200RNWMEG/EU	AE200RNWMEG/EU	AE200RNWMEG/EU				
		Outdoor Unit			AE050RXYDEG/EU	AE080RXYDEG/EU	AE120RXYDEG/EU				
Power Supply					Φ, #, V, Hz	1,2,220-240,50	1,2,220-240,50	1,2,220-240,50			
System	Mode				-	Heat Pump (A2W)	Heat Pump (A2W)	Heat Pump (A2W)			
	Performance	Capacity	Cooling	A2W Condition #1. (A7/W35) <sup>1)*</sup>	W	5,000	7,500	12,000			
					Btu/h	17,100	25,600	40,900			
			Heating	A2W Condition #1. (A7/W35) <sup>1)*</sup>	W	5,000	8,000	12,000			
					Btu/h	17,100	27,300	40,900			
				A2W condition #2	W		4,800	7,400	11,700		
						A2W condition #3		4,300	7,100	11,300	
			A2/W35 <sup>4)*</sup>				4,800	7,000	10,800		
			A-7/W35 <sup>4)*</sup>		5,100	7,350	12,000				
	Power	Power Input	Cooling	A2W Condition #1. (A7/W35) <sup>1)*</sup>	W		1,140	1,900	2,770		
							1,030	1,770	2,650		
			Heating	A2W Condition #1. (A7/W35) <sup>1)*</sup>		A2W condition #2	1,300	2,120	3,180		
						A2W condition #3	1,520	2,530	3,730		
						A2/W35 <sup>4)*</sup>	1,450	2,350	3,300		
						A-7/W35 <sup>4)*</sup>	1,880	3,020	4,710		
		Current Input	Cooling	A2W Condition #1. (A7/W35) <sup>1)*</sup>	A		5.4	9.1	13.2		
						Heating		4.9	8.5	12.2	
		Current	MCA			A	16.0	22.0	28.0		
			MFA			A	20.0	27.5	35.0		
		Efficiency	EER (Nominal Cooling)					4.39	3.95	4.33	
			COP (Nominal Heating) A2W condition #1					4.85	4.52	4.53	
			COP				W/W	A2W condition #2	3.69	3.49	3.68
								A2W condition #3	2.83	2.81	3.03
	A2/W35 <sup>4)*</sup>							3.51	3.16	3.49	
	A-7/W35 <sup>4)*</sup>							2.92	2.60	2.71	
	PdesignH		LWT 35°C				5.5	8.0	13.0		
			LWT 55°C				5.0	8.0	12.0		
	SCOP		35°C				4.46	4.44	4.69		
55°C				3.20	3.23	3.51					
SCOP Class	35°C				A++	A++	A++				
	55°C				A++	A++	A++				
SEER					3.98	4.52	5.22				
Water Connections	Water Flow Rate (Nominal) [H/C]			LPM	14.4/14.4	23.1/21.6	34.6/34.6				
	Water Flow Rate	Min		LPM	7.0	7.0	12.0				
		Max		LPM	48.0	48.0	58.0				
	Water Pressure (Max)				bar	3	3	3			
	Water Pipe Type	threaded male	Inlet	Φ, mm	28	28	28				
			Outlet	Φ, mm	28	28	28				
	Leaving Water Temperature	min/max	Heating	°C	15~65	15~65	15~65				
Cooling			°C	5~25	5~25	5~25					
Refrigerant	Type				-	R32	R32	R32			
	Factory Charging				kg	1.00	1.15	2.20			
					tCO <sub>2</sub> e	0.68	0.78	1.49			
Control Method				-	EEV	EEV	EEV				

## 2. Outdoor Units

### 2-1. Specifications

Model Name		Indoor Unit		AE200RNWMEG/EU	AE200RNWMEG/EU	AE200RNWMEG/EU	
		Outdoor Unit		AE050RXYDEG/EU	AE080RXYDEG/EU	AE120RXYDEG/EU	
Outdoor Unit	Compressor	Type		-	BLDC Twin Rotary	BLDC Twin Rotary	BLDC Twin Rotary
		Model Name		-	UB4TN8200FE4SS	UB8TN8265FJWSG	UB5TN5450FJXSG
		Oil	Type	-	POE	POE	POE
			Initial Charge	cc	650	700	1,700
	Fan	Type		-	Propeller Fan	Propeller Fan	Propeller Fan
		Discharge direction		-	Horizontal	Horizontal	Horizontal
		Air Flow Rate		m <sup>3</sup> /min	51	66	99
		Quantity		EA	1	1	2
	Sound	Sound Pressure	Heating	dB(A)	45	48	50
			Cooling	dB(A)	45	48	50
		Sound Power	Heating	dB(A)	61	63	64
			Cooling	dB(A)	62	64	65
	Connections	Water pipe	inlet	-	BSPP male 1"	BSPP male 1"	BSPP male 1"
			outlet	-	BSPP male 1"	BSPP male 1"	BSPP male 1"
	External Dimension	Net Weight		kg	58.5	76.0	110.0
		Shipping Weight		kg	62.5	84.5	119.0
		Net Dimensions (WxHxD)		mm	880 x 798 x 310	940 x 998 x 330	940 x 1,420 x 330
		Shipping Dimensions (WxHxD)		mm	1,023 x 904 x 413	995 x 1,178 x 426	995 x 1,598 x 426
	Operating Temp. Range	Heating		°C	-25~35	-25~35	-25~35
		Cooling		°C	10~46	10~46	10~46
D.Hot Water		°C	-25~43	-25~43	-25~43		

#### NOTE

- Specifications may be subject to change without prior notice.
  - 1)\* A2W Condition #1 : (Heating) Water In/Out 30°C/35°C, Outdoor Air 7°C[DB]/6°C[WB]; (Cooling) Water In/Out 23°C/18°C, Outdoor Air 35°C[DB].
  - 2)\* A2W Condition #2 : (Heating) Water In/Out 40°C/45°C, Outdoor Air 7°C[DB]/6°C[WB]; (Cooling) Water In/Out 12°C/7°C, Outdoor Air 35°C[DB].
  - 3)\* A2W Condition #3 : (Heating) Water In/Out 47°C/55°C, Outdoor Air 7°C[DB]/6°C[WB].
  - 4)\* A2W Condition : (A2W35) Water In/Out -/35°C, Outdoor Air 2°C[DB]/1°C[WB]; (A-7/W35) Water In/Out -/35°C, Outdoor Air -7°C[DB]/-(× Peak Capacity)
- Select wire size based on the value of MCA
- Sound pressure level is obtained in an anechoic room.
  - Sound pressure level is a relative value, depending on the distance and acoustic environment.
  - Sound pressure level may differ depending on operation condition.
  - dBA = A-weighted sound pressure level
  - Reference acoustic pressure 0 dB = 20uPa
- Sound power level is an absolute value that a sound source generates.
  - dBA = A-weighted Sound power level
  - Reference power : 1pW
  - Measured according to ISO 3741
- These products contain R32 (GWP=675) which is fluorinated greenhouse gas.
- The system is operated in (-25°C ≤ Outdoor temp. < -20°C) condition, but no guarantee of capacity.
- The system is operated by only Booster Heater in special condition (35 °C < Outdoor temp. ≤ 43°C).

## 2. Outdoor Units

### 2-1. Specifications

Model Name		Indoor Unit			AE200RNWMGG/EU	AE260RNWMGG/EU	AE260RNWMGG/EU	AE260RNWMGG/EU					
		Outdoor Unit			AE160RXYDEG/EU	AE080RXYDGG/EU	AE120RXYDGG/EU	AE160RXYDGG/EU					
Power Supply					Φ, #, V, Hz	1,2,220-240,50	3,4,380-415,50	3,4,380-415,50	3,4,380-415,50				
System	Mode				-	Heat Pump (A2W)	Heat Pump (A2W)	Heat Pump (A2W)	Heat Pump (A2W)				
	Performance	Capacity	Cooling	A2W Condition #1. (A7/W35) <sup>1)*</sup>	W	14,000	7,500	12,000	14,000				
					Btu/h	47,800	25,600	40,900	47,800				
			Heating	A2W Condition #1. (A7/W35) <sup>1)*</sup>	W	16,000	8,000	12,000	16,000				
					Btu/h	54,600	27,300	40,900	54,600				
				A2W condition #2	W	15,400	7,400	11,700	15,400				
						A2W condition #3	15,000	7,100	11,300	15,000			
						A2/W35 <sup>4)*</sup>	13,200	7,000	10,800	13,200			
						A-7/W35 <sup>4)*</sup>	14,600	7,350	12,000	14,600			
			Power	Power Input	Cooling	A2W Condition #1. (A7/W35) <sup>1)*</sup>	W	3,280	1,900	2,770	3,280		
								3,620	1,770	2,650	3,620		
	Heating	A2W Condition #1. (A7/W35) <sup>1)*</sup>			A2W condition #2	4,490		2,120	3,180	4,490			
					A2W condition #3	5,180		2,530	3,730	5,180			
					A2/W35 <sup>4)*</sup>	4,400		2,350	3,300	4,400			
					A-7/W35 <sup>4)*</sup>	6,000		3,020	4,710	6,000			
					Current Input	Cooling		A2W Condition #1. (A7/W35) <sup>1)*</sup>	A	15.7	3.0	4.4	5.3
										Heating	17.0	2.8	4.1
	Current	MCA				A		32.0	10.0	10.0	12.0		
		MFA				A		40.0	16.1	16.1	16.1		
	Efficiency	EER (Nominal Cooling)				4.27	3.95	4.33	4.27				
		COP (Nominal Heating) A2W condition #1				4.42	4.52	4.53	4.42				
		COP			A2W condition #2	W/W	3.43	3.49	3.68	3.43			
							A2W condition #3	2.90	2.81	3.03	2.90		
							A2/W35 <sup>4)*</sup>	3.20	3.16	3.49	3.20		
							A-7/W35 <sup>4)*</sup>	2.63	2.60	2.71	2.63		
							PdesignH	LWT 35°C	16.0	8.0	13.0	16.0	
			LWT 55°C	16.0	8.0	12.0	16.0						
		SCOP	35°C			4.48	4.44	4.69	4.48				
55°C			3.53	3.23	3.51	3.53							
SCOP Class		35°C			A++	A++	A++	A++					
		55°C			A++	A++	A++	A++					
SEER				5.31	4.52	5.22	5.31						
Water Connections	Water Flow Rate (Nominal) [H/C]			LPM	46.2/40.4	23.1/21.6	34.6/34.6	46.2/40.4					
	Water Flow Rate	Min		LPM	12.0	7.0	12.0	12.0					
		Max		LPM	58.0	48.0	58.0	58.0					
	Water Pressure (Max)				bar	3	3	3					
	Water Pipe Type	threaded male	Inlet	Φ, mm	28	28	28	28					
			Outlet	Φ, mm	28	28	28	28					
	Leaving Water Temperature	min/max	Heating	°C	15~65	15~65	15~65	15~65					
Cooling			°C	5~25	5~25	5~25	5~25						
Refrigerant	Type			-	R32	R32	R32	R32					
	Factory Charging			kg	2.20	1.15	2.20	2.20					
				tCO <sub>2</sub> e	1.49	0.78	1.49	1.49					
Control Method				-	EEV	EEV	EEV	EEV					

## 2. Outdoor Units

### 2-1. Specifications

Model Name		Indoor Unit		AE200RNWMGG/EU	AE260RNWMGG/EU	AE260RNWMGG/EU	AE260RNWMGG/EU	
		Outdoor Unit		AE160RXYDEG/EU	AE080RXYDGG/EU	AE120RXYDGG/EU	AE160RXYDGG/EU	
Outdoor Unit	Compressor	Type		-	BLDC Twin Rotary	BLDC Twin Rotary	BLDC Twin Rotary	BLDC Twin Rotary
		Model Name		-	UB5TN5450FJXSG	UB8TN8265FJWSG	UB5TN5450FJXSG	UB5TN5450FJXSG
		Oil	Type	-	POE	POE	POE	POE
			Initial Charge	cc	1,700	700	1,700	1,700
	Fan	Type		-	Propeller Fan	Propeller Fan	Propeller Fan	Propeller Fan
		Discharge direction		-	Horizontal	Horizontal	Horizontal	Horizontal
		Air Flow Rate		m <sup>3</sup> /min	118	66	99	118
		Quantity		EA	2	1	2	2
	Sound	Sound Pressure	Heating	dB(A)	52	48	50	52
			Cooling	dB(A)	54	48	50	54
		Sound Power	Heating	dB(A)	66	63	64	66
			Cooling	dB(A)	68	64	65	68
	Connections	Water pipe	inlet	-	BSPP male 1"	BSPP male 1"	BSPP male 1"	BSPP male 1"
			outlet	-	BSPP male 1"	BSPP male 1"	BSPP male 1"	BSPP male 1"
	External Dimension	Net Weight		kg	110.0	75.0	111.0	111.0
		Shipping Weight		kg	119.0	83.5	120.0	120.0
		Net Dimensions (WxHxD)		mm	940 x 1,420 x 330	940 x 998 x 330	940 x 1,420 x 330	940 x 1,420 x 330
		Shipping Dimensions (WxHxD)		mm	995 x 1,598 x 426	995 x 1,178 x 426	995 x 1,598 x 426	995 x 1,598 x 426
	Operating Temp. Range	Heating		°C	-25~35	-25~35	-25~35	-25~35
		Cooling		°C	10~46	10~46	10~46	10~46
D.Hot Water		°C	-25~43	-25~43	-25~43	-25~43		

#### NOTE

- Specifications may be subject to change without prior notice.
  - 1)\* A2W Condition #1 : (Heating) Water In/Out 30°C/35°C, Outdoor Air 7°C[DB]/6°C[WB]; (Cooling) Water In/Out 23°C/18°C, Outdoor Air 35°C[DB].
  - 2)\* A2W Condition #2 : (Heating) Water In/Out 40°C/45°C, Outdoor Air 7°C[DB]/6°C[WB]; (Cooling) Water In/Out 12°C/7°C, Outdoor Air 35°C[DB].
  - 3)\* A2W Condition #3 : (Heating) Water In/Out 47°C/55°C, Outdoor Air 7°C[DB]/6°C[WB].
  - 4)\* A2W Condition : (A2W35) Water In/Out -/35°C, Outdoor Air 2°C[DB]/1°C[WB]; (A-7/W35) Water In/Out -/35°C, Outdoor Air -7°C[DB]/(-× Peak Capacity)
- Select wire size based on the value of MCA
- Sound pressure level is obtained in an anechoic room.
  - Sound pressure level is a relative value, depending on the distance and acoustic environment.
  - Sound pressure level may differ depending on operation condition.
  - dBA = A-weighted sound pressure level
  - Reference acoustic pressure 0 dB = 20uPa
- Sound power level is an absolute value that a sound source generates.
  - dBA = A-weighted Sound power level
  - Reference power : 1pW
  - Measured according to ISO 3741
- These products contain R32 (GWP=675) which is fluorinated greenhouse gas.
- The system is operated in (-25°C ≤ Outdoor temp. < -20°C) condition, but no guarantee of capacity.
- The system is operated by only Booster Heater in special condition (35 °C < Outdoor temp. ≤ 43°C).

## 2. Outdoor Units

### 2-2. Electrical characteristics

Capacity [kW]	Model	Power Supply				Voltage Range [V]		Nominal Running Current [A]		Current [A]	
		Φ	#	Hz	Voltage	Min. (-10%)	Max. (+10%)	Cooling	Heating	MCA	MFA
5.0	AE050RXYDEG/EU	1	2	50	220~240	198	264	5.4	4.9	16.0	20.0
8.0	AE080RXYDEG/EU	1	2	50	220~240	198	264	9.1	8.5	22.0	27.5
12.0	AE120RXYDEG/EU	1	2	50	220~240	198	264	13.2	12.2	28.0	35.0
16.0	AE160RXYDEG/EU	1	2	50	220~240	198	264	15.7	17.0	32.0	40.0
8.0	AE080RXYDGG/EU	3	4	50	380~415	342	456	3.0	2.8	10.0	16.1
12.0	AE120RXYDGG/EU	3	4	50	380~415	342	456	4.4	4.1	10.0	16.1
16.0	AE160RXYDGG/EU	3	4	50	380~415	342	456	5.3	5.7	12.0	16.1

#### NOTE


- MCA : Minimum circuit amperes
- MFA : Maximum fuse amperes
- Select wire size based on the value of MCA

## 2. Outdoor Units

### 2-3. Dimensional drawing

AE050RXYDEG/EU

Units : mm [inches]

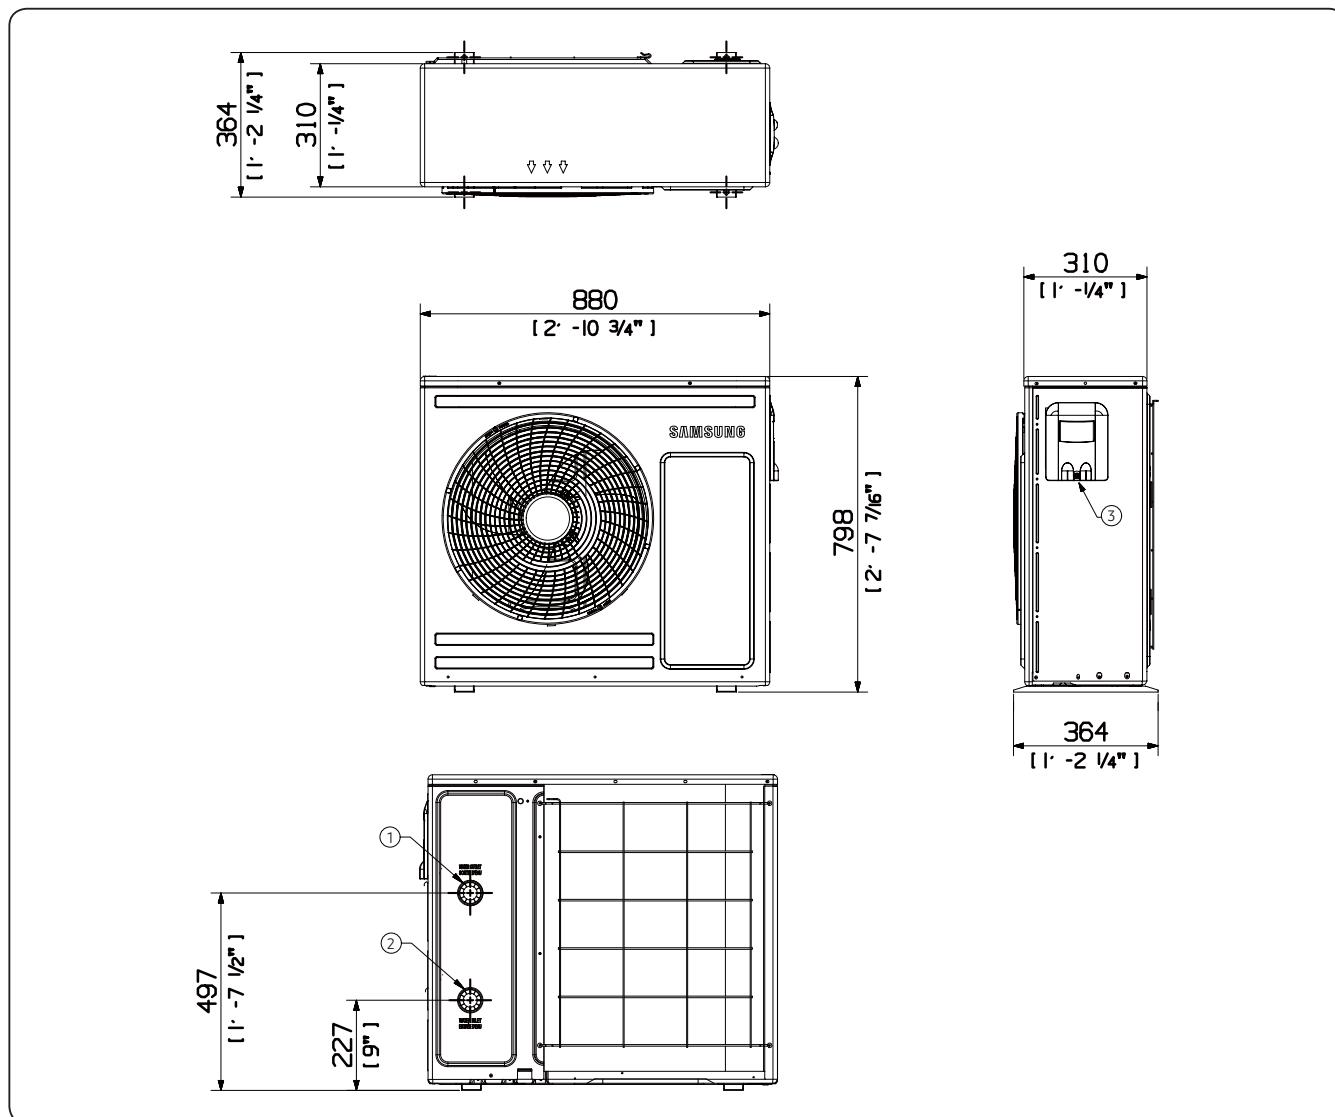

NO	Description
1	Water Pipe(Out)
2	Water Pipe(In)
3	Power & Communication Wiring Conduit Holes




## 2. Outdoor Units

### 2-3. Dimensional drawing

AE080RXYD\*G/EU

Units : mm [inches]

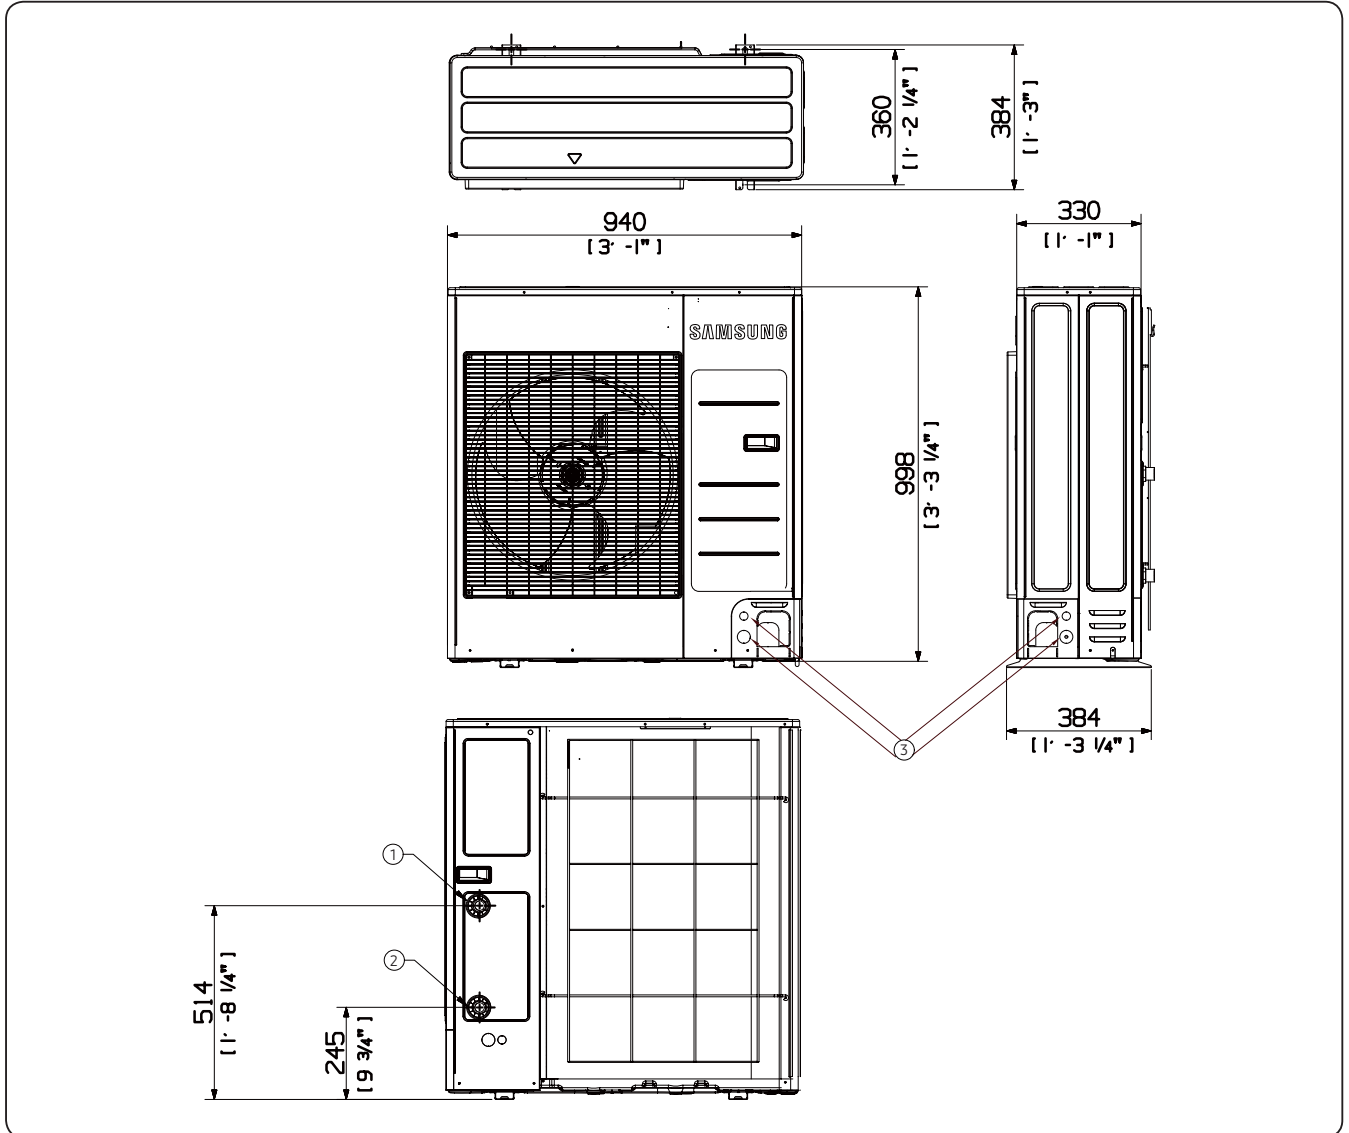


NO	Description
1	Water Pipe(Out)
2	Water Pipe(In)
3	Power & Communication Wiring Conduit Holes

# 2. Outdoor Units

## 2-3. Dimensional drawing

AE120/160RXYD\*G/EU

Units : mm [inches]

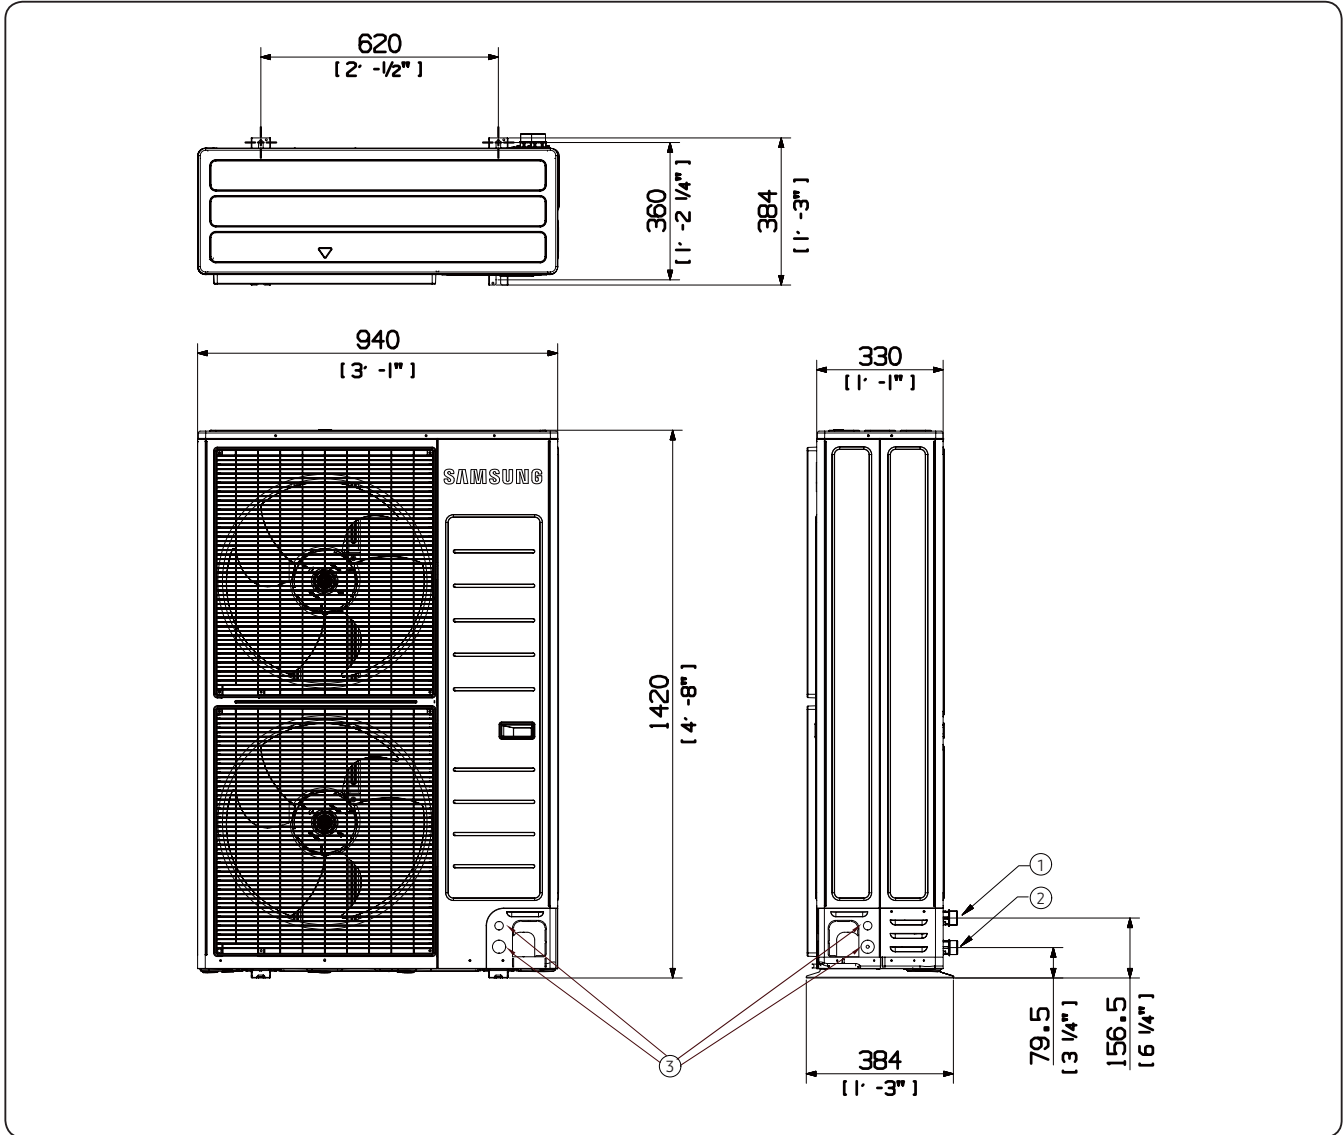


NO	Description
1	Water Pipe(Out)
2	Water Pipe(In)
3	Power & Communication Wiring Conduit Holes

# 2. Outdoor Units

## 2-4. Electrical wiring diagram

### AE050RXYDEG/EU

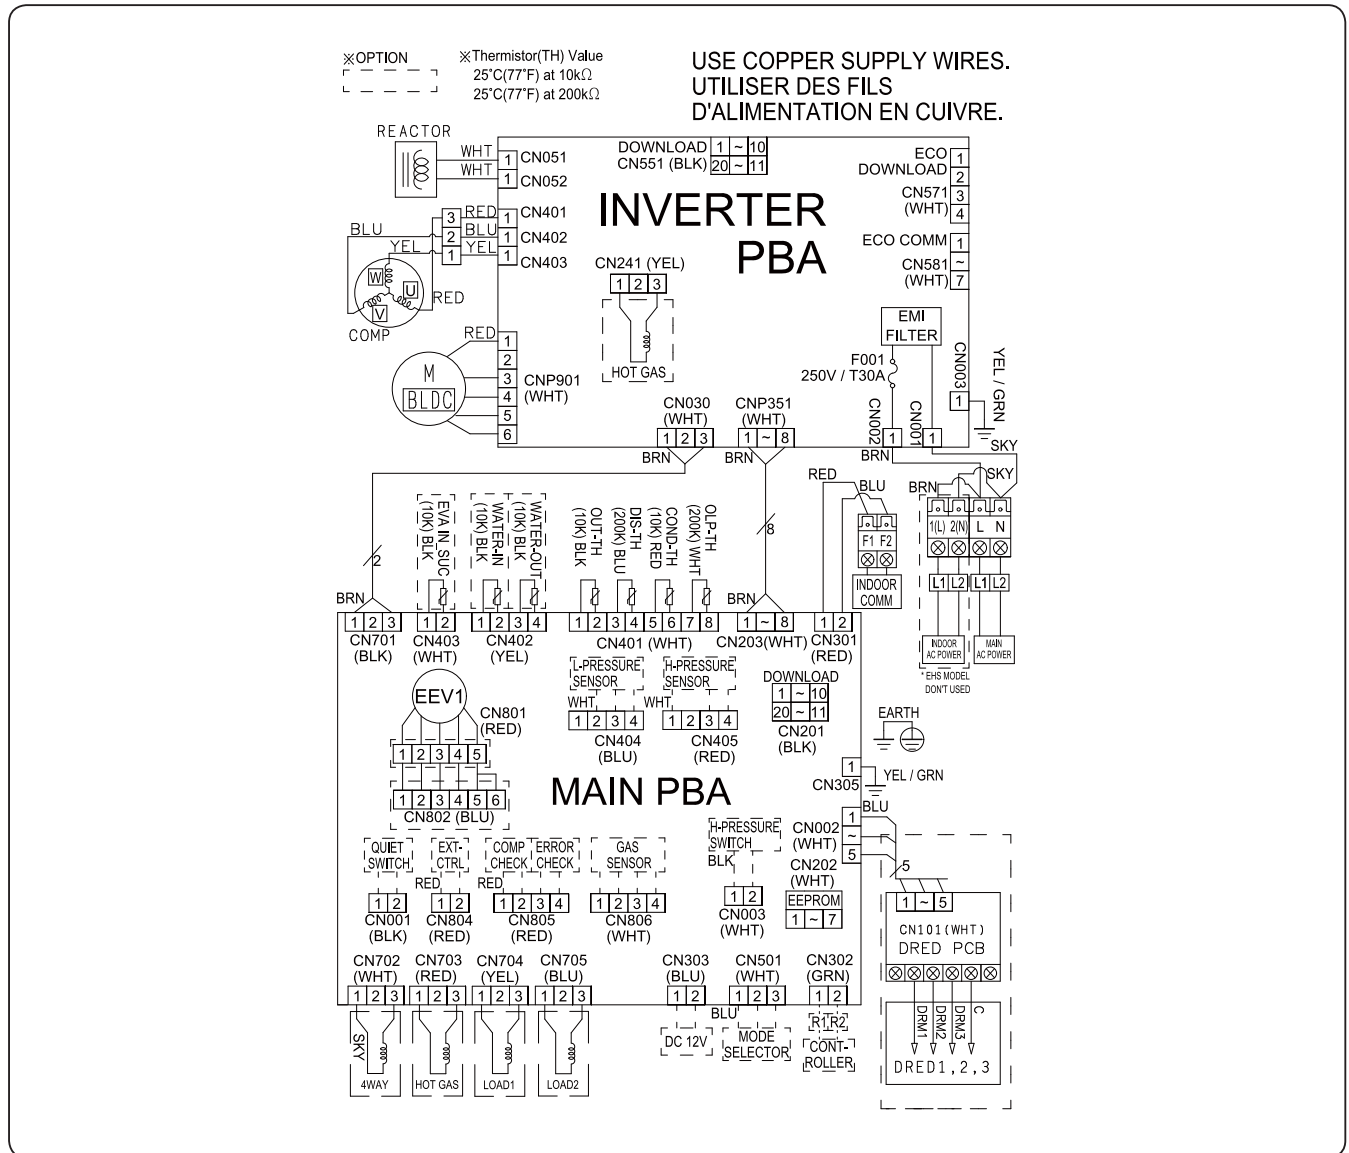

M BLDC	BLDC FAN MOTOR	COMP	COMPRESSOR
OUT-TH	Thermistor OUT(10K)	DIS-TH	Thermistor DISCHARGE(200K)
COND-TH	Thermistor COND(10K)	OLP-TH	Thermistor OLP(200K)


### NOTES

1. This wiring diagram applies only to the Outdoor unit.
2. Symbols show as follow :  
 blk: black, red: red, blu: blue, wht: white, yel: yellow, brn: brown, sky: skyblue, grn: green
3. For connection wiring indoor-outdoor transmission F1-F2, indoor-wired remote controller transmission F3-F4.
4. Protective earth(SCREW)

# 2. Outdoor Units

## 2-4. Electrical wiring diagram

### AE080/120/160RXYDEG/EU

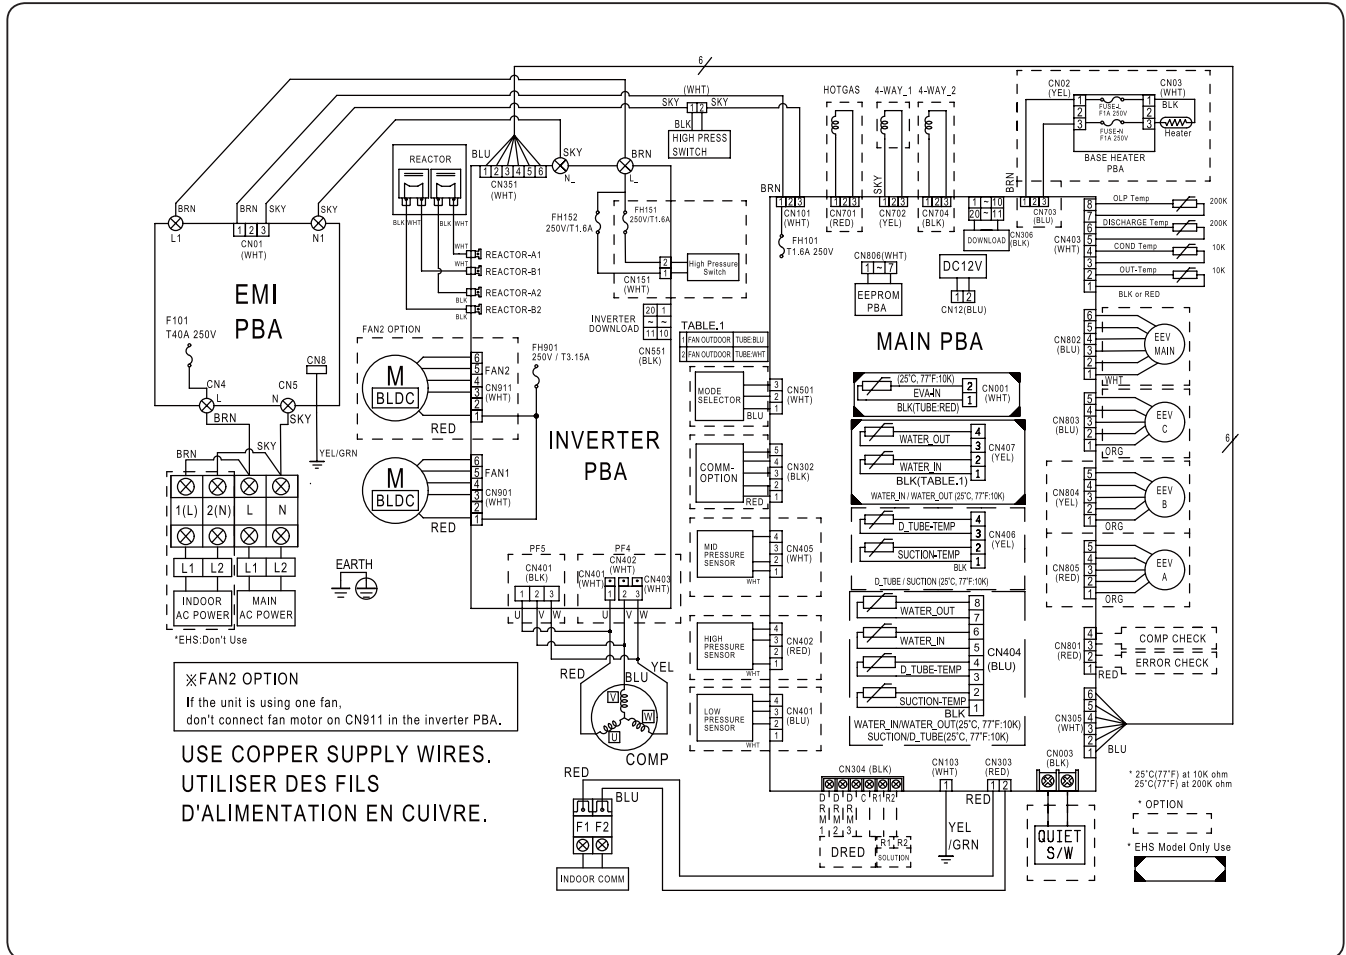

<b>M BLDC</b>	BLDC FAN MOTOR	<b>COMP</b>	COMPRESSOR
<b>Comm</b>	Communication	<b>OUT-Temp</b>	Thermistor OUT(10K)
<b>COND-Temp</b>	Thermistor COND(10K)	<b>DISCHARGE-Temp</b>	Thermistor DISCHARGE(200K)
<b>OLP-Temp</b>	Thermistor OLP(200K)	<b>SUCTION-TEMP</b>	Thermistor SUCTION(10K)


### NOTES

1. This wiring diagram applies only to the Outdoor unit.
2. Symbols show as follow :  
 blk: black, red: red, blu: blue, wht: white, yel: yellow, brn: brown, sky: skyblue, grn: green
3. For connection wiring indoor-outdoor transmission F1-F2, indoor-wired remote controller transmission F3-F4.
4. Protective earth(SCREW)

# 2. Outdoor Units

## 2-4. Electrical wiring diagram

### AE080/120/160RXYDGG/EU

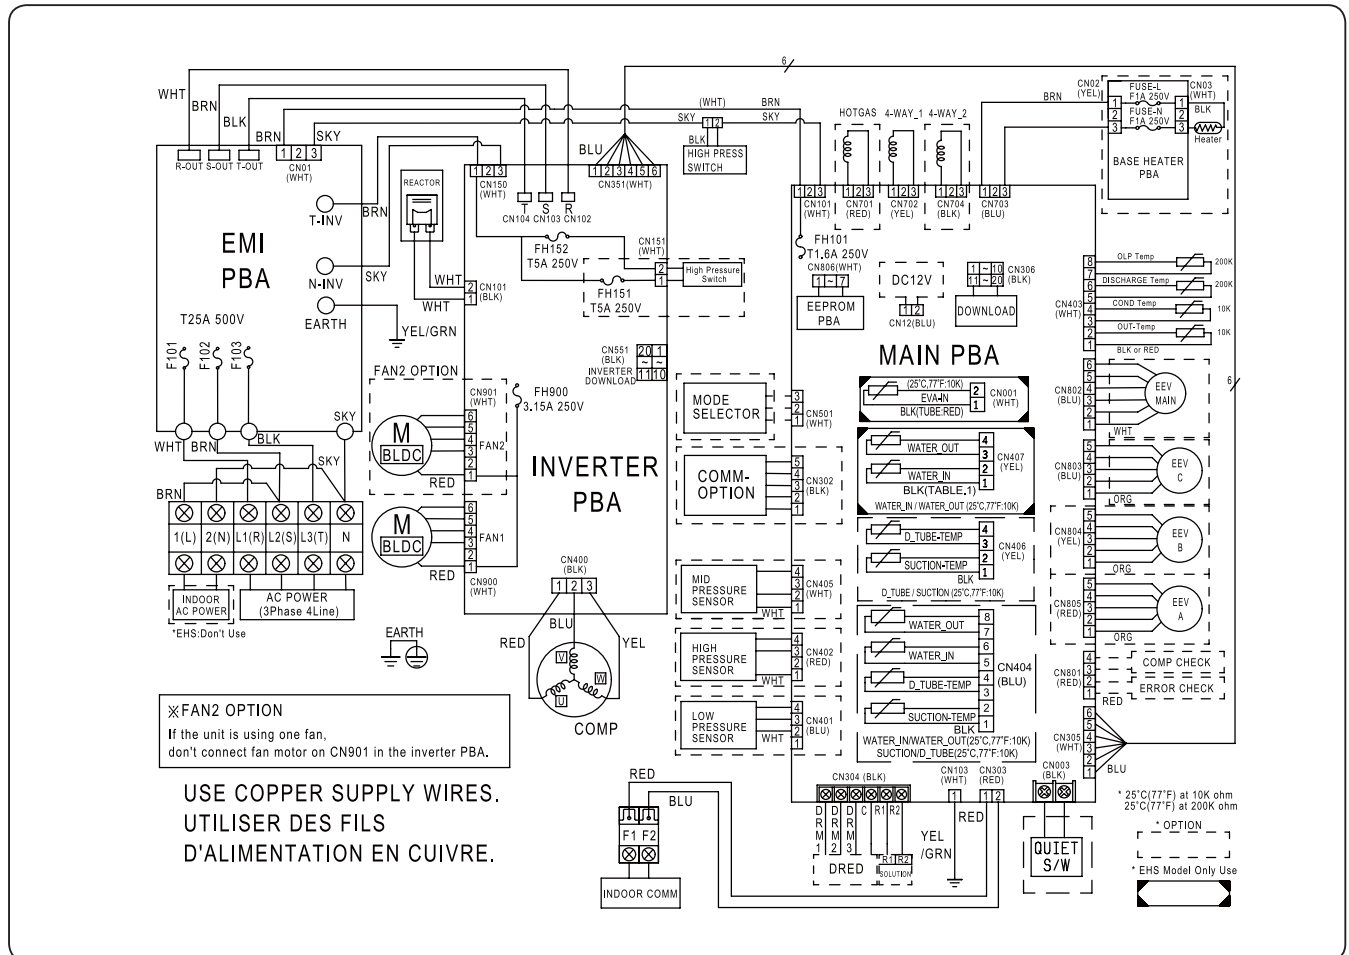

### NOTES

1. This wiring diagram applies only to the Outdoor unit.
2. Symbols show as follow :  
blk: black, red: red, blu: blue, wht: white, yel: yellow, brn: brown, sky: skyblue, grn: green
3. For connection wiring indoor-outdoor transmission F1-F2, indoor-wired remote controller transmission F3-F4.
4. Protective earth(SCREW)

## 2. Outdoor Units

---

### 2-5. Sound data

---

#### Summary

Capacity (kW)	Model	Sound Pressure dB(A)		Sound Power dB(A)
		Cooling	Heating	Heating
5.0	AE050RXYDEG/EU	45	45	61
8.0	AE080RXYDEG/EU	48	48	63
12.0	AE120RXYDEG/EU	50	50	64
16.0	AE160RXYDEG/EU	54	52	66
8.0	AE080RXYDGG/EU	48	48	63
12.0	AE120RXYDGG/EU	50	50	64
16.0	AE160RXYDGG/EU	54	52	66

#### NOTE


- Specifications may be subject to change without prior notice.
- Sound Pressure Level
  - Sound pressure level is obtained in an anechoic room.
  - Sound pressure level is a relative value, depending on the distance and acoustic environment.
  - Sound pressure level may differ depending on operation condition.
  - dBA = A-weighted sound pressure level
  - Reference acoustic pressure 0 dB = 20μPa
- Sound Power Level
  - Sound power level is an absolute value that a sound source generates.
  - dBA = A-weighted sound power level.
  - Reference power : 1pW.
  - Measured according to ISO 3741.

# 2. Outdoor Units

## 2-5. Sound data

### Sound Pressure level


Unit: dB(A)

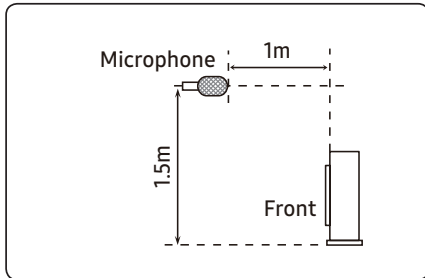


Model	Cooling	Heating
AE050RXYDEG/EU	45	45
AE080RXYDEG/EU	48	48
AE120RXYDEG/EU	50	50
AE160RXYDEG/EU	54	52

- NR Curve


1) AE050RXYDEG/EU

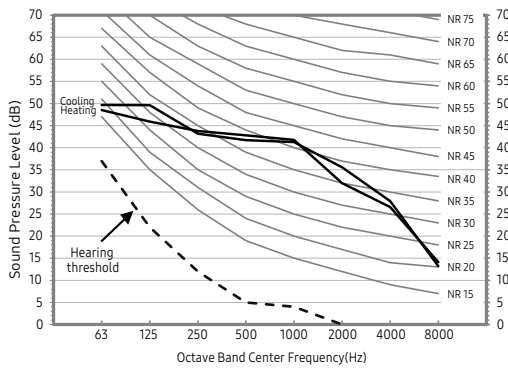


2) AE080RXYDEG/EU

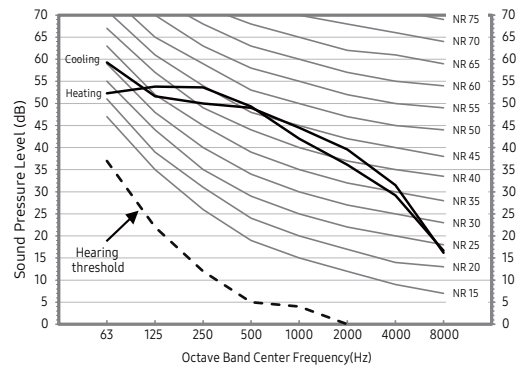

3) AE120RXYDEG/EU

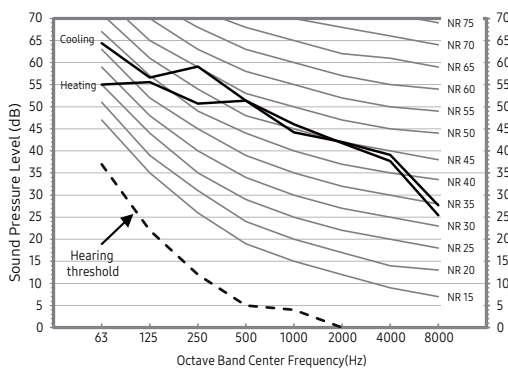

4) AE160RXYDEG/EU

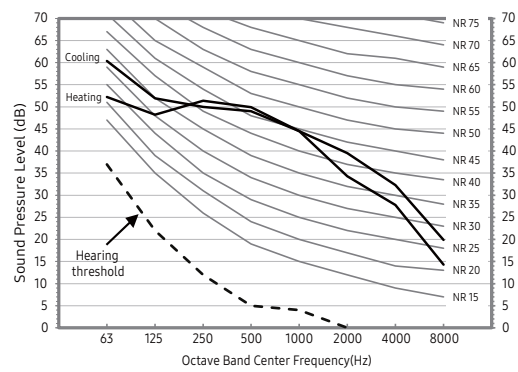




# 2. Outdoor Units

## 2-5. Sound data

### Sound Pressure level


Unit: dB(A)

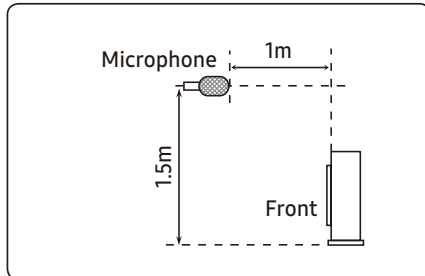


Model	Cooling	Heating
AE080RXYDGG/EU	48	48
AE120RXYDGG/EU	50	50
AE160RXYDGG/EU	54	52

- NR Curve


5) AE080RXYDGG/EU

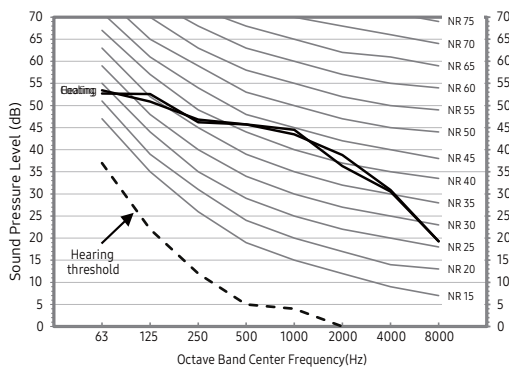

6) AE120RXYDGG/EU

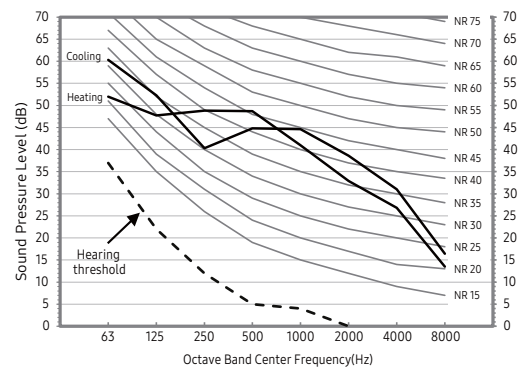

7) AE160RXYDGG/EU

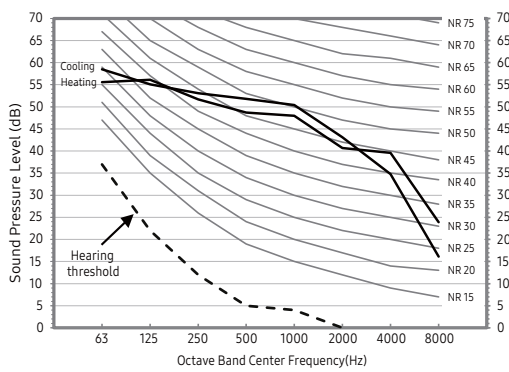

# 2. Outdoor Units

## 2-5. Sound data


### Sound Power level

**NOTE**


- Specifications may be subject to change without prior notice
  - Sound power level is an absolute value that a sound source generates.
  - dBA = A-weighted sound power level.
  - Reference power : 1pW.
  - Measured according to ISO 3741.

Model	Power (dBA)
AE050RXYDEG/EU	61
AE080RXYDEG/EU	63
AE120RXYDEG/EU	64
AE160RXYDEG/EU	66


1) AE050RXYDEG/EU

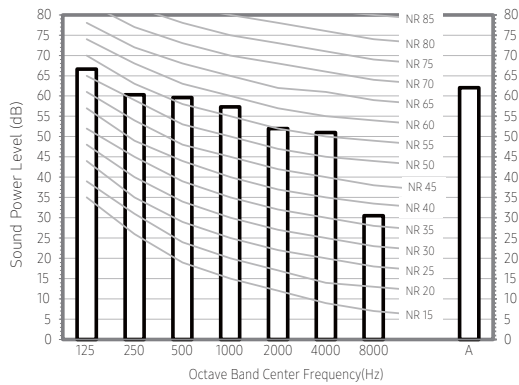


2) AE080RXYDEG/EU

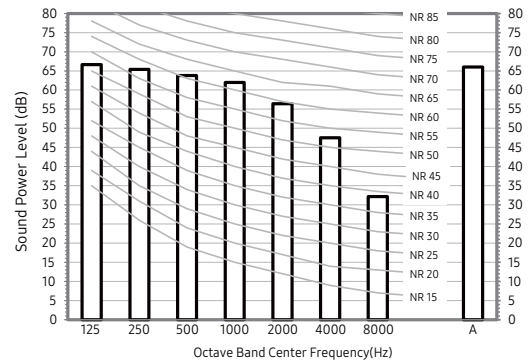

3) AE120RXYDEG/EU

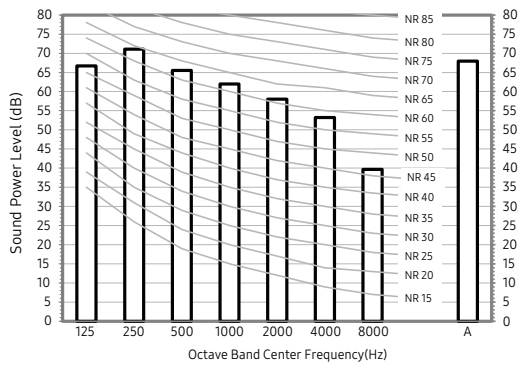

4) AE160RXYDEG/EU

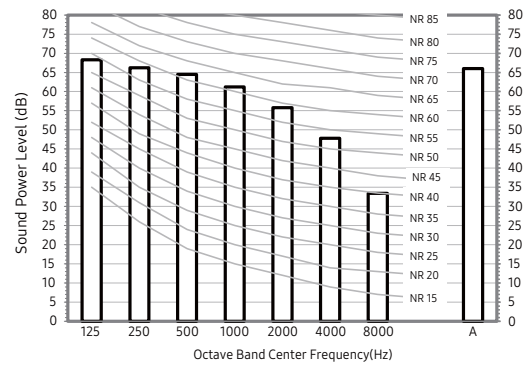

# 2. Outdoor Units

## 2-5. Sound data


### Sound Power level

**NOTE**


- Specifications may be subject to change without prior notice
  - Sound power level is an absolute value that a sound source generates.
  - dBA = A-weighted sound power level.
  - Reference power : 1pW.
  - Measured according to ISO 3741.

Model	Power (dBA)
AE080RXYDGG/EU	63
AE120RXYDGG/EU	64
AE160RXYDGG/EU	66


5) AE080RXYDGG/EU

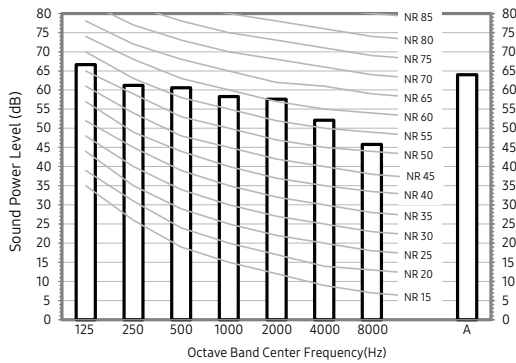

6) AE120RXYDGG/EU

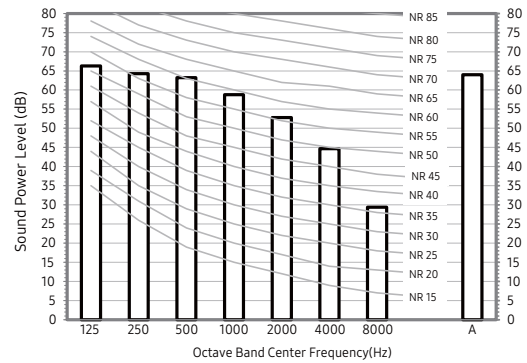


7) AE160RXYDGG/EU

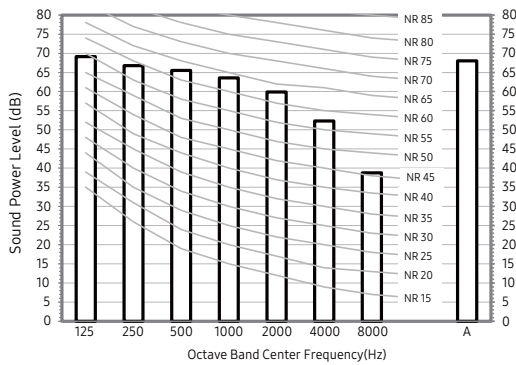


# 2. Outdoor Units

## 2-6. Operation range

### 1) Cooling

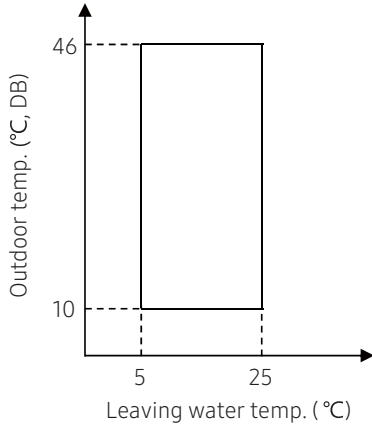

### 2) Heating

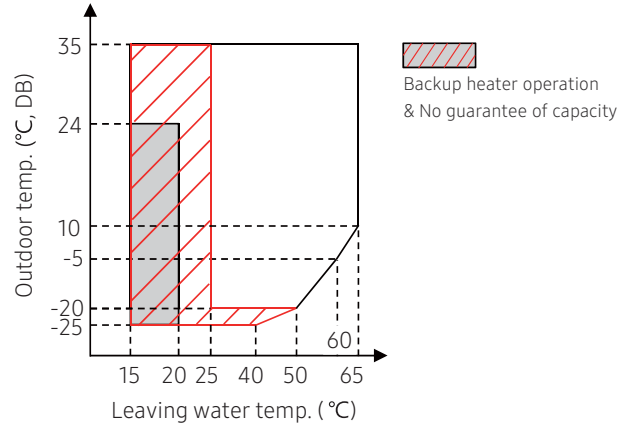

MONO Outdoor Unit		Water Temp. (°C)			Water Flow Rates (LPM)			Air Temp. (°C, DB/WB)		
		Min	Std	Max	Min	Std	Max	Min	Std	Max
Controller	Cooling	5	-	25						
	Heating	15	-	65						
Cooling	Inlet	-	23 (12 <sup>*2</sup> )	30	12 (7 <sup>*1</sup> )	Δ 5°C	58 (48 <sup>*1</sup> )	10/-	35/24	46/28
	Outlet	5	18 (7 <sup>*2</sup> )	25				-25/-	7/6	35/24
Heating	Inlet	5	30 (40 <sup>*2</sup> )	-						
	Outlet	25 (15 <sup>*3</sup> )	35 (45 <sup>*2</sup> )	65						


\*1) Model : AE050RXYDEG  
AE080RXYDEG  
AE080RXYDGG

\*2) Eurovent Test Condition #2

\*3) Back up heater operation.

※ Operation of outdoor unit possible, but no guarantee of capacity in this condition. (-25°C ≤ Outdoor temp < -20°C)

### 3) DHW (Domestic Hot Water Tank)

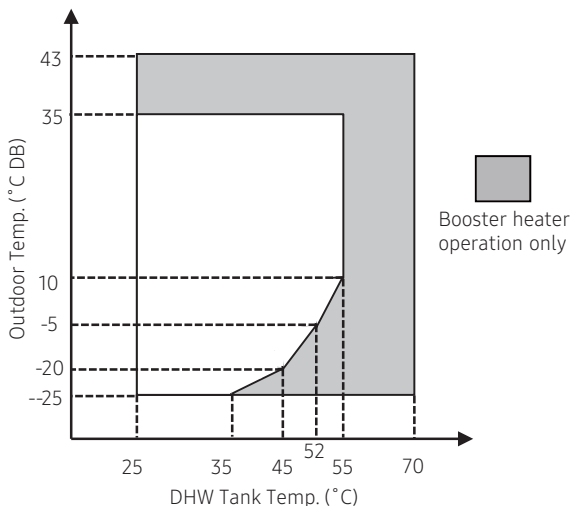


※ Special condition( 35°C < Outdoor temp. ≤ 43°C) is operated by only Booster Heater.  
SAMSUNG doesn't supply DHW for EHS Split.  
Since it is a reference data, you have to check DHW operation range for yours.


# 2. Outdoor Units

## 2-7. Piping diagram

AE050/080RXD\*G/EU

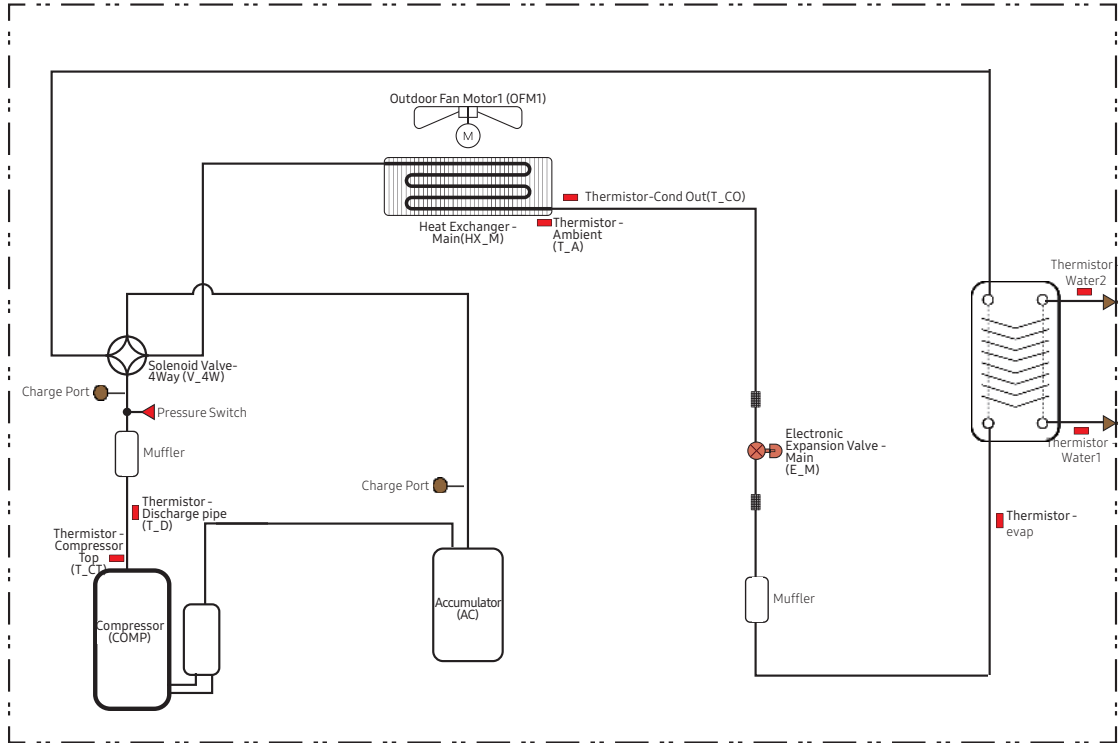

AE120/160RXD\*G/EU

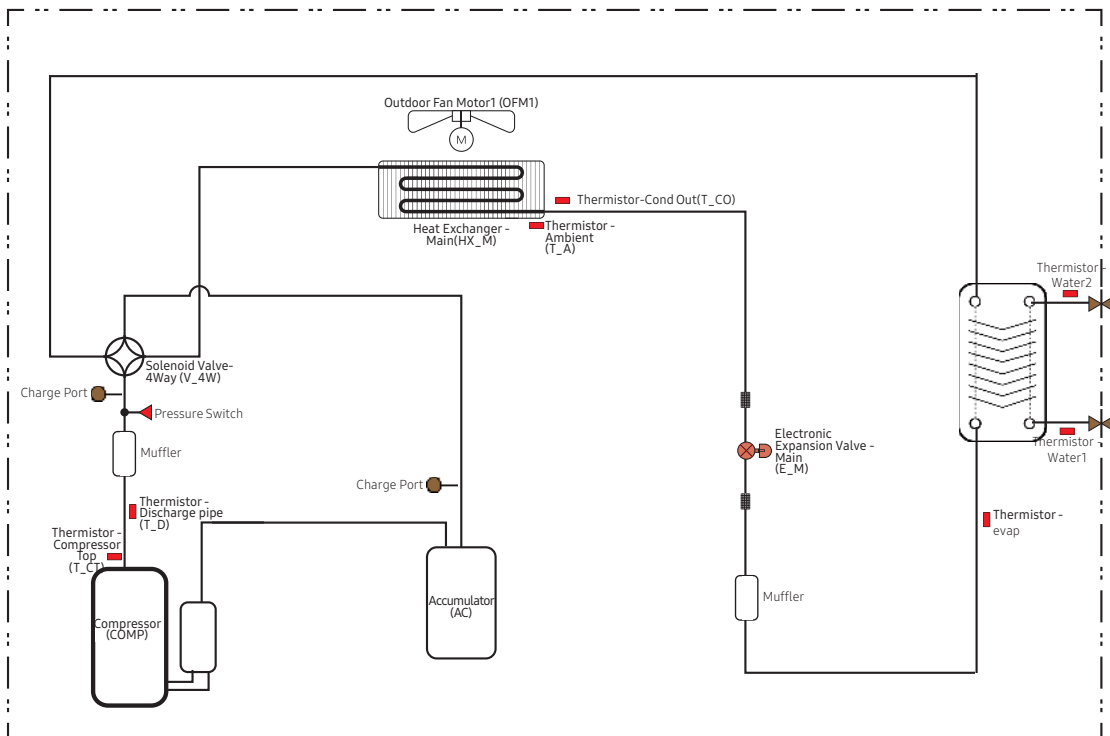

# 2. Outdoor Units

## 2-8. Capacity table

### 1) Maximum Heating Capacity (Peak Value)

LWT (Leaving Water Temp.), Tamb (Ambient Temp.), HC (Heating Capacity), PI (Power input)

	LWT(°C)	30		35		40		45		50		55		60		65		
	Tamb (°C)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	
AE050RXYDEG	-20	3.57	1.42	3.40	1.60	3.41	1.69	3.43	1.98									
	-15	4.52	1.65	4.30	1.85	4.17	1.94	4.03	2.02	3.91	2.12							
	-10	5.25	1.73	5.00	1.94	4.85	2.03	4.70	2.12	4.56	2.23	4.23	2.44					
	-7	5.58	1.74	5.31	1.96	5.20	2.21	5.08	2.46	4.97	2.68	4.86	2.91					
	-2	5.91	1.68	5.63	1.89	5.41	2.08	5.20	2.26	4.94	2.54	4.68	2.83	4.43	3.14			
	2	5.86	1.50	5.58	1.69	5.27	1.78	4.97	1.88	4.72	2.12	4.47	2.35	4.23	2.50			
	7	5.25	0.92	5.00	1.03	4.90	1.17	4.80	1.30	4.55	1.41	4.30	1.52	4.08	1.56	3.85	1.60	
	10	5.73	0.92	5.46	1.04	5.38	1.18	5.29	1.31	5.03	1.48	4.76	1.64	4.53	1.69	4.29	1.74	
	15	6.54	0.94	6.23	1.05	6.17	1.18	6.12	1.33	5.81	1.50	5.51	1.66	5.23	1.72	4.95	1.77	
	20	7.35	0.95	7.00	1.07	6.97	1.20	6.94	1.35	6.59	1.52	6.25	1.69	5.93	1.74	5.62	1.79	
AE080RXYD*G	-20	5.60	2.21	5.33	2.48	5.27	2.70	5.20	3.13									
	-15	6.63	2.45	6.31	2.75	6.22	2.97	6.12	3.19	5.94	3.35							
	-10	8.02	2.71	7.64	3.05	7.41	3.20	7.18	3.35	6.97	3.52	6.46	3.85					
	-7	8.04	2.80	7.66	3.15	7.43	3.30	7.20	3.46	6.57	3.73	5.95	4.01					
	-2	8.56	2.72	8.15	3.05	7.89	3.21	7.62	3.38	7.24	3.80	6.86	4.22	6.50	4.69			
	2	8.55	2.43	8.14	2.73	7.85	2.89	7.56	3.05	7.18	3.43	6.80	3.81	6.44	4.04			
	7	8.40	1.58	8.00	1.77	7.70	1.95	7.40	2.12	7.25	2.33	7.10	2.53	6.96	2.62	6.81	2.72	
	10	9.23	1.57	8.79	1.77	8.53	1.97	8.28	2.17	7.86	2.44	7.45	2.71	7.08	2.79	6.70	2.88	
	15	10.60	1.56	10.10	1.76	9.92	1.97	9.74	2.24	9.25	2.52	8.76	2.80	8.33	2.89	7.89	2.98	
	20	11.98	1.56	11.41	1.75	11.31	2.01	11.20	2.32	10.64	2.61	10.08	2.90	9.58	2.99	9.07	3.08	
AE120RXYD*G	-20	9.82	4.08	9.35	4.58	9.04	4.68	8.72	4.88									
	-15	11.13	4.25	10.60	4.78	10.43	4.88	10.26	4.98	9.95	5.23							
	-10	12.39	4.32	11.80	4.85	11.45	5.04	11.09	5.23	10.76	5.49	9.98	6.01					
	-7	13.13	4.37	12.50	4.91	11.95	5.39	11.40	5.88	10.84	6.36	10.28	6.84					
	-2	13.60	4.05	12.95	4.55	12.72	5.09	12.48	5.62	11.85	6.32	11.23	7.02	10.64	7.80			
	2	13.19	3.42	12.56	3.84	12.69	4.39	12.81	4.94	12.17	5.56	11.53	6.18	10.93	6.56			
	7	12.60	2.36	12.00	2.65	11.85	2.92	11.70	3.18	11.50	3.46	11.30	3.73	11.11	3.83	10.91	3.94	
	10	13.91	2.34	13.25	2.63	13.06	2.88	12.87	3.14	12.22	3.53	11.58	3.92	11.00	4.05	10.42	4.17	
	15	16.09	2.30	15.32	2.59	15.07	2.79	14.81	3.07	14.07	3.45	13.33	3.84	12.66	3.96	11.99	4.08	
	20	18.27	2.27	17.40	2.55	17.08	2.75	16.75	3.00	15.91	3.38	15.08	3.75	14.32	3.87	13.57	3.98	
AE160RXYD*G	-20	11.87	5.05	11.30	5.67	10.99	6.04	10.68	6.61									
	-15	13.65	5.34	13.00	6.00	12.79	6.37	12.57	6.74	12.19	7.08							
	-10	15.12	5.47	14.40	6.15	13.97	6.61	13.54	7.08	13.13	7.43	12.18	8.14					
	-7	15.97	5.56	15.21	6.25	15.27	7.05	15.32	7.84	14.36	7.96	13.40	8.07					
	-2	16.59	5.26	15.80	5.91	15.24	6.42	14.69	6.93	13.95	7.79	13.22	8.66	12.52	9.62			
	2	16.12	4.55	15.35	5.12	14.15	5.27	12.95	5.42	12.31	6.10	11.66	6.77	11.04	7.19			
	7	16.80	3.22	16.00	3.62	15.70	4.06	15.40	4.49	15.20	4.84	15.00	5.18	14.81	5.28	14.61	5.38	
	10	18.25	3.26	17.38	3.66	17.09	4.10	16.80	4.54	15.96	5.10	15.12	5.67	14.37	5.85	13.61	6.02	
	15	20.68	3.33	19.69	3.74	19.42	4.11	19.14	4.61	18.18	5.19	17.23	5.77	16.37	5.95	15.50	6.13	
	20	23.10	3.39	22.00	3.81	21.74	4.21	21.48	4.69	20.41	5.28	19.33	5.86	18.37	6.05	17.40	6.23	

1. Heating capacity : Capacity is according to Eurovent rating standard OM-3-2015 and valid for heated water range  $\Delta t = 3\sim 8^{\circ}\text{C}$
  2. Cooling capacity : Capacity is according to Eurovent rating standard OM-3-2015 and valid for chilled water range  $\Delta t = 3\sim 8^{\circ}\text{C}$
  3. Power input : Power input is according to Eurovent rating standard OM-3-2015.
  4. Peak value : Tested without defrost operation in accordance with EN14511
- ※ The real capacity would be changed according to the install environment.

# 2. Outdoor Units

## 2-8. Capacity table

### 2) Maximum Heating Capacity (Integrated Value)

LWT (Leaving Water Temp.), Tamb (Ambient Temp.), HC (Heating Capacity), PI (Power input)

	LWT(°C)	30		35		40		45		50		55		60		65	
	Tamb(°C)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)
	AE050RXYDEG	-20	3.57	1.42	3.40	1.60	3.41	1.69	3.43	1.98							
	-15	4.47	1.63	4.26	1.83	4.12	1.92	3.99	2.00	3.87	2.10						
	-10	5.15	1.69	4.90	1.90	4.75	1.99	4.61	2.08	4.47	2.18	4.15	2.39				
	-7	5.36	1.67	5.10	1.88	4.99	2.12	4.88	2.36	4.78	2.58	4.67	2.79				
	-2	5.20	1.48	4.95	1.67	4.76	1.83	4.58	1.99	4.35	2.24	4.12	2.49	3.90	2.76		
	2	5.04	1.29	4.80	1.45	4.54	1.54	4.27	1.62	4.06	1.82	3.84	2.03	3.64	2.25		
	7	5.25	0.92	5.00	1.03	4.90	1.17	4.80	1.30	4.55	1.41	4.30	1.52	4.08	1.56	3.85	1.60
	10	5.73	0.92	5.46	1.04	5.38	1.18	5.29	1.31	5.03	1.48	4.76	1.64	4.53	1.69	4.29	1.74
	15	6.54	0.94	6.23	1.05	6.17	1.18	6.12	1.33	5.81	1.50	5.51	1.66	5.23	1.72	4.95	1.77
	20	7.35	0.95	7.00	1.07	6.97	1.20	6.94	1.35	6.59	1.52	6.25	1.69	5.93	1.74	5.62	1.79
AE080RXYD*G	LWT(°C)	30		35		40		45		50		55		60		65	
	Tamb(°C)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)
	-20	5.60	2.21	5.33	2.48	5.27	2.70	5.20	3.13								
	-15	6.56	2.42	6.25	2.72	6.15	2.94	6.06	3.16	5.88	3.32						
	-10	7.86	2.66	7.49	2.99	7.26	3.14	7.04	3.28	6.83	3.45	6.33	3.77				
	-7	7.72	2.69	7.35	3.02	7.13	3.17	6.91	3.32	6.31	3.59	5.71	3.85				
	-2	7.53	2.39	7.18	2.69	6.94	2.83	6.71	2.97	6.37	3.34	6.03	3.71	5.72	4.13		
	2	7.35	2.09	7.00	2.35	6.75	2.49	6.50	2.62	6.18	2.95	5.85	3.28	5.54	3.64		
	7	8.40	1.58	8.00	1.77	7.70	1.95	7.40	2.12	7.25	2.33	7.10	2.53	6.96	2.62	6.81	2.72
	10	9.23	1.57	8.79	1.77	8.53	1.97	8.28	2.17	7.86	2.44	7.45	2.71	7.08	2.79	6.70	2.88
	15	10.60	1.56	10.10	1.76	9.92	1.97	9.74	2.24	9.25	2.52	8.76	2.80	8.33	2.89	7.89	2.98
	20	11.98	1.56	11.41	1.75	11.31	2.01	11.20	2.32	10.64	2.61	10.08	2.90	9.58	2.99	9.07	3.08
AE120RXYD*G	LWT(°C)	30		35		40		45		50		55		60		65	
	Tamb(°C)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)
	-20	9.82	4.08	9.35	4.58	9.04	4.68	8.72	4.88								
	-15	11.02	4.21	10.49	4.73	10.33	4.83	10.16	4.93	9.85	5.18						
	-10	12.14	4.23	11.56	4.75	11.22	4.94	10.87	5.12	10.54	5.38	9.78	5.89				
	-7	12.60	4.19	12.00	4.71	11.47	5.18	10.94	5.64	10.41	6.11	9.87	6.57				
	-2	11.97	3.56	11.40	4.01	11.19	4.48	10.98	4.95	10.43	5.56	9.88	6.18	9.36	6.87		
	2	11.34	2.94	10.80	3.30	10.91	3.78	11.02	4.25	10.47	4.78	9.92	5.31	9.40	5.90		
	7	12.60	2.36	12.00	2.65	11.85	2.92	11.70	3.18	11.50	3.46	11.30	3.73	11.11	3.83	10.91	3.94
	10	13.91	2.34	13.25	2.63	13.06	2.88	12.87	3.14	12.22	3.53	11.58	3.92	11.00	4.05	10.42	4.17
	15	16.09	2.30	15.32	2.59	15.07	2.79	14.81	3.07	14.07	3.45	13.33	3.84	12.66	3.96	11.99	4.08
	20	18.27	2.27	17.40	2.55	17.08	2.75	16.75	3.00	15.91	3.38	15.08	3.75	14.32	3.87	13.57	3.98
AE160RXYD*G	LWT(°C)	30		35		40		45		50		55		60		65	
	Tamb(°C)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)	HC(kW)	PI(kW)
	-20	11.87	5.05	11.30	5.67	10.99	6.04	10.68	6.61								
	-15	13.51	5.29	12.87	5.94	12.66	6.31	12.44	6.67	12.07	7.01						
	-10	14.82	5.36	14.11	6.03	13.69	6.48	13.27	6.94	12.87	7.28	11.94	7.98				
	-7	15.33	5.34	14.60	6.00	14.66	6.77	14.71	7.53	13.79	7.64	12.86	7.75				
	-2	14.60	4.63	13.90	5.20	13.41	5.65	12.93	6.10	12.28	6.86	11.63	7.62	11.02	8.47		
	2	13.86	3.92	13.20	4.40	12.17	4.53	11.14	4.66	10.58	5.24	10.03	5.83	9.50	6.47		
	7	16.80	3.22	16.00	3.62	15.70	4.06	15.40	4.49	15.20	4.84	15.00	5.18	14.81	5.28	14.61	5.38
	10	18.25	3.26	17.38	3.66	17.09	4.10	16.80	4.54	15.96	5.10	15.12	5.67	14.37	5.85	13.61	6.02
	15	20.68	3.33	19.69	3.74	19.42	4.11	19.14	4.61	18.18	5.19	17.23	5.77	16.37	5.95	15.50	6.13
	20	23.10	3.39	22.00	3.81	21.74	4.21	21.48	4.69	20.41	5.28	19.33	5.86	18.37	6.05	17.40	6.23

1. Heating capacity : Capacity is according to Eurovent rating standard OM-3-2015 and valid for heated water range  $\Delta t = 3\sim 8^{\circ}\text{C}$
  2. Cooling capacity : Capacity is according to Eurovent rating standard OM-3-2015 and valid for chilled water range  $\Delta t = 3\sim 8^{\circ}\text{C}$
  3. Power input : Power input is according to Eurovent rating standard OM-3-2015.
  4. Peak value : Tested without defrost operation in accordance with EN14511
- ※ The real capacity would be changed according to the install environment.



## 2. Outdoor Units

### 2-8. Capacity table

#### 3) Cooling Capacity

LWT (Leaving Water Temp.), Tamb (Ambient Temp.), CC (Cooling Capacity), PI (Power input)

	LWT(°C)	7		10		13		15		18		25	
	Tamb(°C)	CC(kW)	PI(kW)	CC(kW)	PI(kW)	CC(kW)	PI(kW)	CC(kW)	PI(kW)	CC(kW)	PI(kW)	CC(kW)	PI(kW)
AE050RXYDEG	10	4.32	0.86	4.62	0.85	4.93	0.85	5.23	0.85	5.54	0.85	6.09	0.87
	20	4.15	0.97	4.45	0.97	4.74	0.97	5.03	0.97	5.33	0.96	5.86	0.98
	30	3.99	1.09	4.27	1.08	4.55	1.08	4.83	1.08	5.11	1.08	5.62	1.10
	35	3.90	1.15	4.18	1.15	4.45	1.15	4.73	1.14	5.00	1.14	5.50	1.16
	46	3.72	1.27	3.98	1.27	4.24	1.27	4.50	1.26	4.77	1.26	5.24	1.28
	AE080RXYD*G	10	6.31	1.40	6.92	1.33	7.53	1.26	8.14	1.19	8.75	1.12	9.62
20		6.07	1.59	6.66	1.51	7.24	1.43	7.83	1.35	8.41	1.27	9.25	1.29
30		5.83	1.78	6.39	1.69	6.95	1.60	7.51	1.51	8.07	1.42	8.88	1.45
35		5.70	1.88	6.25	1.79	6.80	1.69	7.35	1.60	7.90	1.50	8.69	1.53
46		5.43	2.08	5.96	1.97	6.48	1.87	7.00	1.76	7.53	1.66	8.28	1.69
AE120RXYD*G		10	9.96	2.03	10.79	2.04	11.62	2.05	12.45	2.06	13.28	2.06	14.61
	20	9.59	2.31	10.38	2.32	11.18	2.32	11.98	2.33	12.78	2.34	14.06	2.39
	30	9.20	2.58	9.96	2.59	10.73	2.60	11.50	2.61	12.26	2.62	13.49	2.67
	35	9.00	2.73	9.75	2.74	10.50	2.75	11.25	2.76	12.00	2.77	13.20	2.83
	46	8.58	3.02	9.29	3.03	10.01	3.04	10.72	3.05	11.44	3.06	12.58	3.12
	AE160RXYD*G	10	11.51	2.45	12.51	2.45	13.51	2.45	14.50	2.45	15.50	2.44	17.05
20		11.08	2.78	12.03	2.78	12.99	2.78	13.95	2.77	14.91	2.77	16.40	2.83
30		10.63	3.11	11.55	3.11	12.47	3.10	13.39	3.10	14.31	3.10	15.74	3.16
35		10.40	3.29	11.30	3.29	12.20	3.29	13.10	3.28	14.00	3.28	15.40	3.35
46		9.91	3.64	10.77	3.63	11.63	3.63	12.48	3.63	13.34	3.62	14.68	3.70

1. Heating capacity : Capacity is according to Eurovent rating standard OM-3-2015 and valid for heated water range  $\Delta t = 3\sim 8^{\circ}\text{C}$
  2. Cooling capacity : Capacity is according to Eurovent rating standard OM-3-2015 and valid for chilled water range  $\Delta t = 3\sim 8^{\circ}\text{C}$
  3. Power input : Power input is according to Eurovent rating standard OM-3-2015.
- ※ The real capacity would be changed according to the install environment.

## 2. Outdoor Units

---

### 2-9. Silent mode corrections

---

#### Heating

Silent Function	Outdoor Air Temperature(°C DB)			
	-15	2	7	15
Level 1	0.92	0.87	0.94	0.94
Level 2	0.82	0.78	0.84	0.84
Level 3	0.68	0.64	0.69	0.69
Low-noise	0.7	0.6	0.69	0.69

#### Heating

Silent Function	Outdoor Air Temperature(°C DB)			
	10	20	35	45
Level 1	1	1	0.92	0.92
Level 2	0.98	0.89	0.83	0.83
Level 3	0.81	0.74	0.68	0.68

# 3. Tank integrated hydro unit

## 3-1. Specifications

Model Name		Indoor Unit	AE200RNWMEG/EU	AE200RNWMEG/EU	AE200RNWMEG/EU	
		Outdoor Unit	AE050RXYDEG/EU	AE080RXYDEG/EU	AE120RXYDEG/EU	
Mode		-	Heat Pump (A2W)	Heat Pump (A2W)	Heat Pump (A2W)	
Power Supply		Φ, #, V, Hz	1,2,220-240,50	1,2,220-240,50	1,2,220-240,50	
Power input	Cooling (Nominal)	kW	0.2	0.2	0.2	
	Heating (Nominal)	kW	0.2	0.2	0.2	
	Cooling (Max)	kW	0.2	0.2	0.2	
	Heating (Max)	kW	5.2	5.2	5.2	
Current Input	Cooling (Nominal)	A	0.9	0.9	0.9	
	Heating (Nominal)	A	0.9	0.9	0.9	
	Cooling (Max)	A	0.9	0.9	0.9	
	Heating (Max)	A	22.7	22.7	22.7	
Field Wiring	MCA	A	22.7	22.7	22.7	
	MFA		28.4	28.4	28.4	
Water Heating	Declared load profile	-	L	L	L	
	Energy efficiency Class	-	A+	A+	A	
Water Connections	Water Flow Rate (Std)[H/C]		LPM	14.4/14.4	23.1/21.6	34.6/34.6
	Water Pressure (Max)		bar	3	3	3
	Water pipe (To outdoor unit)	Type	-	Straight pipe	Straight pipe	Straight pipe
		Inlet	Φ, mm	28	28	28
		Outlet	Φ, mm	28	28	28
	Water pipe (Space heating)	Type	-	Straight pipe	Straight pipe	Straight pipe
		Inlet	Φ, mm	28	28	28
		Outlet	Φ, mm	28	28	28
	Water pipe (DHW)	Type	-	Straight pipe	Straight pipe	Straight pipe
		Inlet	Φ, mm	22	22	22
		Outlet	Φ, mm	22	22	22
	Water pipe (Secondary water return, Only 260L optional)	Type	-	-	-	-
		Inlet	Φ, mm	-	-	-
	Leaving Water Temperature	Heating	°C	15~65	15~65	15~65
Cooling		°C	5~25	5~25	5~25	
DHW Tank	Nominal Water Volume		liter	200	200	200
	Net Water Volume		liter	194	194	194
	Material		-	SUS 316L	SUS 316L	SUS 316L
	Max. water pressure		bar	10	10	10
	Max. water temperature		°C	70	70	70
	Immersion heater (= booster heater)		kW	3 (230V)	3 (230V)	3 (230V)
	Insulation		-	PU Foam	PU Foam	PU Foam
Water Pump	Type		-	Centrifurugal (UPMM 25-9.5)	Centrifurugal (UPMM 25-9.5)	Centrifurugal (UPMM 25-9.5)
	Motor Input		W	100	100	100
	Number of Unit		EA	1	1	1
Backup Heater	Power		kW	2 (230V)	2 (230V)	2 (230V)
Safety device	Pressure relief valve		bar	2.9	2.9	2.9
	Flow Sensor		LPM	5~60	5~60	5~60
	Temperature & Pressure relief valve (Tank)		bar, °C	7, 90	7, 90	7, 90
	Thermostat(for immersion heater)		°C	49~82±5 (Auto, On : 15°C±3°C↓)	49~82±5 (Auto, On : 15°C±3°C↓)	49~82±5 (Auto, On : 15°C±3°C↓)

# 3. Tank integrated hydro unit

## 3-1. Specifications

Model Name		Indoor Unit		AE200RNWMEG/EU	AE200RNWMEG/EU	AE200RNWMEG/EU
		Outdoor Unit		AE050RXYDEG/EU	AE080RXYDEG/EU	AE120RXYDEG/EU
Expansion vessel	Internal water volume	liter	8	8	8	
	Working pressure	MPa	0.3	0.3	0.3	
Water Pump (Primary)	Type	-	BLDC Inv	BLDC Inv	BLDC Inv	
	Max static pressure	mAq	9.5	9.5	9.5	
Water Heat Exchanger	Type	-	Braszed Plate Exchager	Braszed Plate Exchager	Braszed Plate Exchager	
	Internal water volume	L	1.01(Water Side) 0.98(Refrigerant Side)	1.01(Water Side) 0.98(Refrigerant Side)	1.01(Water Side) 0.98(Refrigerant Side)	
IP Class		-	IPX1	IPX1	IPX1	
Air Purge Valve		Φ, inch	BSPP male 3/8"	BSPP male 3/8"	BSPP male 3/8"	
Sound	Sound Pressure	Heating	dB(A)	26	26	30
		Cooling	dB(A)	26	26	30
	Sound Power	Heating	dB(A)	40	40	44
External Dimension	Net Weight		kg	130.0	130.0	130.0
	Shipping Weight		kg	142.0	142.0	142.0
	Net Dimensions (WxHxD)		mm	595 x 1,800 x 700	595 x 1,800 x 700	595 x 1,800 x 700
	Shipping Dimensions (WxHxD)		mm	700 x 2,000 x 780	700 x 2,000 x 780	700 x 2,000 x 780

### NOTE

- Specifications may be subject to change without prior notice.

# 3. Tank integrated hydro unit

## 3-1. Specifications

Model Name		Indoor Unit		AE200RNWMEG/EU	AE260RNWMEG/EU	AE260RNWMEG/EU	
		Outdoor Unit		AE160RXYDEG/EU	AE080RXYDEG/EU	AE120RXYDEG/EU	
Mode				Heat Pump (A2W)	Heat Pump (A2W)	Heat Pump (A2W)	
Power Supply		Φ, #, V, Hz		1,2,220-240,50	1,2,220-240,50	1,2,220-240,50	
Power input	Cooling (Nominal)	kW		0.2	0.2	0.2	
	Heating (Nominal)	kW		0.2	0.2	0.2	
	Cooling (Max)	kW		0.2	0.2	0.2	
	Heating (Max)	kW		5.2	5.2	5.2	
Current Input	Cooling (Nominal)	A		0.9	0.9	0.9	
	Heating (Nominal)	A		0.9	0.9	0.9	
	Cooling (Max)	A		0.9	0.9	0.9	
	Heating (Max)	A		22.7	22.7	22.7	
Field Wiring	MCA	A		22.7	22.7	22.7	
	MFA			28.4	28.4	28.4	
Water Heating	Declared load profile			L	XL	XL	
	Energy efficiency Class			A	A+	A	
Water Connections	Water Flow Rate (Std)[H/C]		LPM	46.2/40.4	23.1/21.6	34.6/34.6	
	Water Pressure (Max)		bar	3	3	3	
	Water pipe (To outdoor unit)	Type			Straight pipe	Straight pipe	Straight pipe
		Inlet	Φ, mm		28	28	28
		Outlet	Φ, mm		28	28	28
	Water pipe (Space heating)	Type			Straight pipe	Straight pipe	Straight pipe
		Inlet	Φ, mm		28	28	28
		Outlet	Φ, mm		28	28	28
	Water pipe (DHW)	Type			Straight pipe	Straight pipe	Straight pipe
		Inlet	Φ, mm		22	22	22
		Outlet	Φ, mm		22	22	22
	Water pipe (Secondary water return, Only 260L optional)	Type			-	Straight pipe	Straight pipe
		Inlet	Φ, mm		-	22	22
	Leaving Water Temperature	Heating	°C		15~65	15~65	15~65
Cooling		°C		5~25	5~25	5~25	
DHW Tank	Nominal Water Volume		liter	200	260	260	
	Net Water Volume		liter	194	254	254	
	Material			SUS 316L	SUS 316L	SUS 316L	
	Max. water pressure		bar	10	10	10	
	Max. water temperature		°C	70	70	70	
	Immersion heater (= booster heater)		kW	3 (230V)	3 (230V)	3 (230V)	
	Insulation			PU Foam	PU Foam	PU Foam	
Water Pump	Type			Centrifurugal (UPMM 25-9.5)	Centrifurugal (UPMM 25-9.5)	Centrifurugal (UPMM 25-9.5)	
	Motor Input		W	100	100	100	
	Number of Unit		EA	1	1	1	
Backup Heater	Power		kW	2 (230V)	2 (230V)	2 (230V)	
Safety device	Pressure relief valve		bar	2.9	2.9	2.9	
	Flow Sensor		LPM	5~60	5~60	5~60	
	Temperature & Pressure relief valve (Tank)		bar, °C	7, 90	7, 90	7, 90	
	Thermostat(for immersion heater)		°C	49~82±5 (Auto, On : 15°C±3°C↓)	49~82±5 (Auto, On : 15°C±3°C↓)	49~82±5 (Auto, On : 15°C±3°C↓)	

## 3. Tank integrated hydro unit

### 3-1. Specifications

Model Name		Indoor Unit		AE200RNWMEG/EU	AE260RNWMEG/EU	AE260RNWMEG/EU
		Outdoor Unit		AE160RXYDEG/EU	AE080RXYDEG/EU	AE120RXYDEG/EU
Expansion vessel	Internal water volume	liter	8	8	8	
	Working pressure	MPa	0.3	0.3	0.3	
Water Pump (Primary)	Type	-	BLDC Inv	BLDC Inv	BLDC Inv	
	Max static pressure	mAq	9.5	9.5	9.5	
Water Heat Exchanger	Type	-	Braszed Plate Exchager	Braszed Plate Exchager	Braszed Plate Exchager	
	Internal water volume	L	1.01(Water Side) 0.98(Refrigerant Side)	1.01(Water Side) 0.98(Refrigerant Side)	1.01(Water Side) 0.98(Refrigerant Side)	
IP Class		-	IPX1	IPX1	IPX1	
Air Purge Valve		Φ, inch	BSPP male 3/8"	BSPP male 3/8"	BSPP male 3/8"	
Sound	Sound Pressure	Heating	dB(A)	30	26	30
		Cooling	dB(A)	30	26	30
	Sound Power	Heating	dB(A)	44	40	44
External Dimension	Net Weight		kg	130.0	140.0	140.0
	Shipping Weight		kg	142.0	152.0	152.0
	Net Dimensions (WxHxD)		mm	595 x 1,800 x 700	595 x 1,800 x 700	595 x 1,800 x 700
	Shipping Dimensions (WxHxD)		mm	700 x 2,000 x 780	700 x 2,000 x 780	700 x 2,000 x 780

#### NOTE

- Specifications may be subject to change without prior notice

# 3. Tank integrated hydro unit

## 3-1. Specifications

Model Name		Indoor Unit	AE260RNWMGG/EU	AE260RNWMGG/EU	AE260RNWMGG/EU	AE260RNWMGG/EU	
		Outdoor Unit	AE160RXYDEG/EU	AE080RXYDGG/EU	AE120RXYDGG/EU	AE160RXYDGG/EU	
Mode		-	Heat Pump (A2W)	Heat Pump (A2W)	Heat Pump (A2W)	Heat Pump (A2W)	
Power Supply		Φ, #, V, Hz	1,2,220-240,50	1,2,220-240,50 3,4,380-415,50	1,2,220-240,50 3,4,380-415,50	1,2,220-240,50 3,4,380-415,50	
Power input	Cooling (Nominal)	kW	0.2	3Φ - / 1Φ 0.20	3Φ - / 1Φ 0.20	3Φ - / 1Φ 0.20	
	Heating (Nominal)	kW	0.2	3Φ - / 1Φ 0.20	3Φ - / 1Φ 0.20	3Φ - / 1Φ 0.20	
	Cooling (Max)	kW	0.2	3Φ - / 1Φ 0.20	3Φ - / 1Φ 0.20	3Φ - / 1Φ 0.20	
	Heating (Max)	kW	5.2	3Φ 6.00 / 1Φ 3.20	3Φ 6.00 / 1Φ 3.20	3Φ 6.00 / 1Φ 3.20	
Current Input	Cooling (Nominal)	A	0.9	3Φ - / 1Φ 0.9	3Φ - / 1Φ 0.9	3Φ - / 1Φ 0.9	
	Heating (Nominal)	A	0.9	3Φ - / 1Φ 0.9	3Φ - / 1Φ 0.9	3Φ - / 1Φ 0.9	
	Cooling (Max)	A	0.9	3Φ - / 1Φ 0.9	3Φ - / 1Φ 0.9	3Φ - / 1Φ 0.9	
	Heating (Max)	A	22.7	3Φ 8.7 / 1Φ 14.0	3Φ 8.7 / 1Φ 14.0	3Φ 8.7 / 1Φ 14.0	
Field Wiring	MCA	A	22.7	3Φ 8.7 / 1Φ 14.0	3Φ 8.7 / 1Φ 14.0	3Φ 8.7 / 1Φ 14.0	
	MFA		28.4	3Φ 10.9 / 1Φ 17.5	3Φ 10.9 / 1Φ 17.5	3Φ 10.9 / 1Φ 17.5	
Water Heating	Declared load profile	-	XL	XL	XL	XL	
	Energy efficiency Class	-	A	A+	A	A	
Water Connections	Water Flow Rate (Std)[H/C]		LPM	46.2/40.4	23.1/21.6	34.6/34.6	46.2/40.4
	Water Pressure (Max)		bar	3	3	3	3
	Water pipe (To outdoor unit)	Type	-	Straight pipe	Straight pipe	Straight pipe	Straight pipe
		Inlet	Φ, mm	28	28	28	28
		Outlet	Φ, mm	28	28	28	28
	Water pipe (Space heating)	Type	-	Straight pipe	Straight pipe	Straight pipe	Straight pipe
		Inlet	Φ, mm	28	28	28	28
		Outlet	Φ, mm	28	28	28	28
	Water pipe (DHW)	Type	-	Straight pipe	Straight pipe	Straight pipe	Straight pipe
		Inlet	Φ, mm	22	22	22	22
		Outlet	Φ, mm	22	22	22	22
	Water pipe (Secondary water return, Only 260L optional)	Type	-	Straight pipe	Straight pipe	Straight pipe	Straight pipe
		Inlet	Φ, mm	22	22	22	22
	Leaving Water Temperature	Heating	°C	15~65	15~65	15~65	15~65
Cooling		°C	5~25	5~25	5~25	5~25	
DHW Tank	Nominal Water Volume		liter	260	260	260	260
	Net Water Volume		liter	254	254	254	254
	Material		-	SUS 316L	SUS 316L	SUS 316L	SUS 316L
	Max. water pressure		bar	10	10	10	10
	Max. water temperature		°C	70	70	70	70
	Immersion heater (= booster heater)		kW	3 (230V)	3 (230V)	3 (230V)	3 (230V)
	Insulation		-	PU Foam	PU Foam	PU Foam	PU Foam
Water Pump	Type		-	Centrifurugal (UPMM 25-9.5)	Centrifurugal (UPMM 25-9.5)	Centrifurugal (UPMM 25-9.5)	Centrifurugal (UPMM 25-9.5)
	Motor Input		W	100	100	100	100
	Number of Unit		EA	1	1	1	1
Backup Heater	Power		kW	2 (230V)	6 (3Φ 400V)	6 (3Φ 400V)	6 (3Φ 400V)
Safety device	Pressure relief valve		bar	2.9	2.9	2.9	2.9
	Flow Sensor		LPM	5~60	5~60	5~60	5~60
	Temperature & Pressure relief valve (Tank)		bar, °C	7, 90	7, 90	7, 90	7, 90
	Thermostat(for immersion heater)		°C	49~82±5 (Auto, On : 15°C±3°C↓)	49~82±5 (Auto, On : 15°C±3°C↓)	49~82±5 (Auto, On : 15°C±3°C↓)	49~82±5 (Auto, On : 15°C±3°C↓)



# 3. Tank integrated hydro unit

## 3-1. Specifications

Model Name		Indoor Unit		AE260RNWMEG/EU	AE260RNWMGG/EU	AE260RNWMGG/EU	AE260RNWMGG/EU
		Outdoor Unit		AE160RXYDEG/EU	AE080RXYDGG/EU	AE120RXYDGG/EU	AE160RXYDGG/EU
Expansion vessel	Internal water volume	liter	8	8	8	8	
	Working pressure	MPa	0.3	0.3	0.3	0.3	
Water Pump (Primary)	Type	-	BLDC Inv	BLDC Inv	BLDC Inv	BLDC Inv	
	Max static pressure	mAq	9.5	9.5	9.5	9.5	
Water Heat Exchanger	Type	-	Braszed Plate Exchager	Braszed Plate Exchager	Braszed Plate Exchager	Braszed Plate Exchager	
	Internal water volume	L	1.01(Water Side) 0.98(Refrigerant Side)	1.01(Water Side) 0.98(Refrigerant Side)	1.01(Water Side) 0.98(Refrigerant Side)	1.01(Water Side) 0.98(Refrigerant Side)	
IP Class		-	IPX1	IPX1	IPX1	IPX1	
Air Purge Valve		Φ, inch	BSPP male 3/8"	BSPP male 3/8"	BSPP male 3/8"	BSPP male 3/8"	
Sound	Sound Pressure	Heating	dB(A)	30	26	30	30
		Cooling	dB(A)	30	26	30	30
	Sound Power	Heating	dB(A)	44	40	44	44
External Dimension	Net Weight		kg	140.0	140.0	140.0	140.0
	Shipping Weight		kg	152.0	152.0	152.0	152.0
	Net Dimensions (WxHxD)		mm	595 x 1,800 x 700	595 x 1,800 x 700	595 x 1,800 x 700	595 x 1,800 x 700
	Shipping Dimensions (WxHxD)		mm	700 x 2,000 x 780	700 x 2,000 x 780	700 x 2,000 x 780	700 x 2,000 x 780

### NOTE


- Specifications may be subject to change without prior notice

# 3. Tank integrated hydro unit

## 3-2. Dimensional drawing

AE200/260RNW\*\*G/EU

Unit : mm

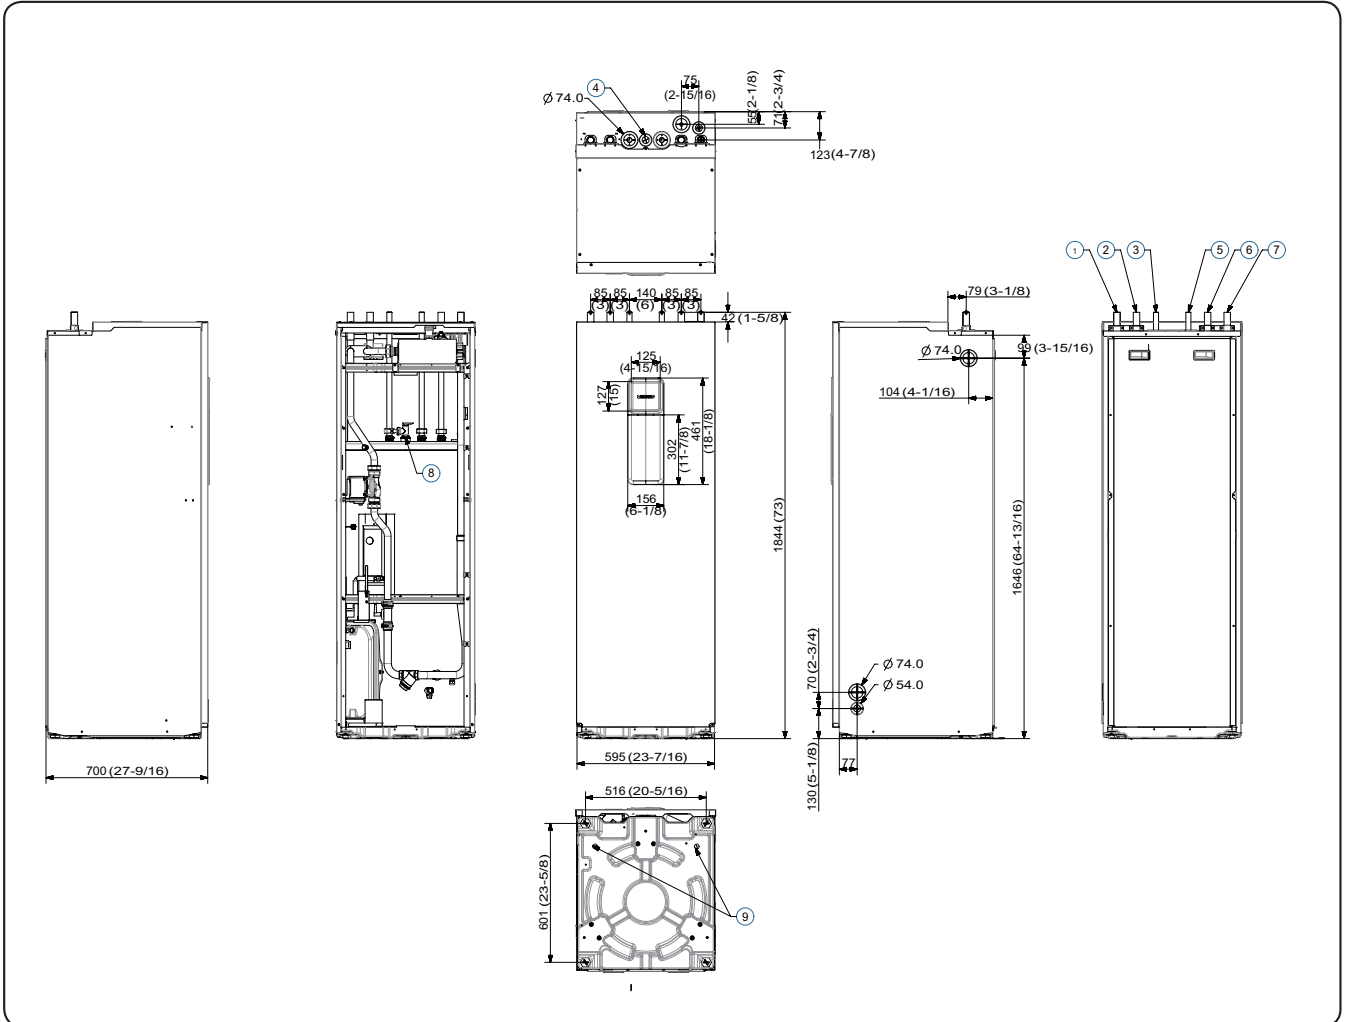


NO	Name	Description	
		AE200RNWSEG/EU	AE260RNWM*G/EU
1	Space heating Inlet	ø28	ø28
2	Space heating Outlet	ø28	ø28
3	DHW Inlet	ø22	ø22
4	Secondary water return	N/A	ø22
5	DHW Outlet	ø22	ø22
6	Heat Pump In	ø28	ø28
7	Heat Pump Out	ø28	ø28
8	T/P v/v	Female PT1/2"	Female PT1/2"
9	Drain Holes	(Option) Connect with the provided drain plug	

# 3. Tank integrated hydro unit

## 3-3. Electrical wiring diagram

### AE200/260RNWMEG/EU

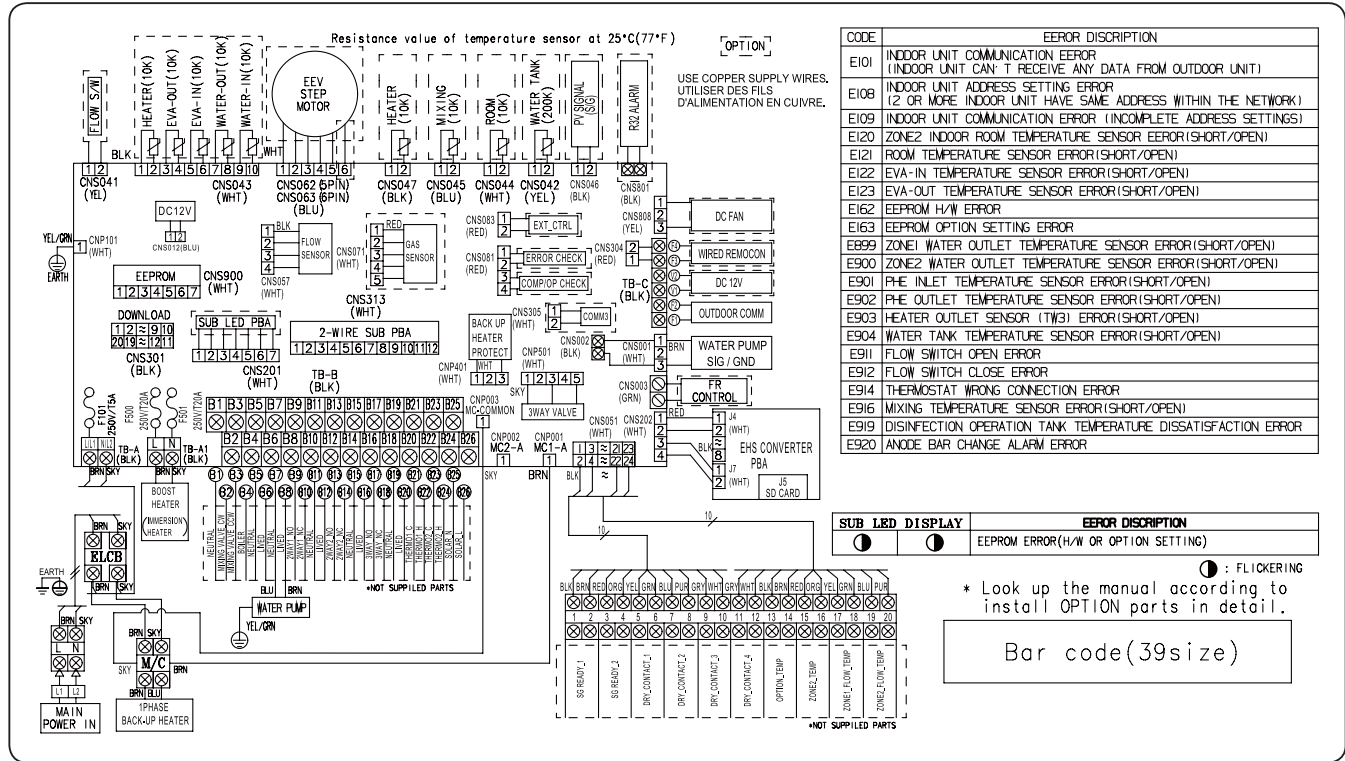

HEATER	Thermistor HEATER(10K)	EVA-OUT	Thermistor EVA-OUT(10K)
EVA-IN	Thermistor EVA-IN(10K)	WATER-OUT	Thermistor WATER-OUT(10K)
WATER-IN	Thermistor WATER-IN(10K)	WATER TANK	Thermistor WATER TANK(200K)
MIXING	Thermistor MIXING VALVE(10K)	WIRED REMOCON	Wired Remote Controller
OUTDOOR COMM	Outdoor Communication	SIG/GND	Signal/Ground
ELCB	Earth Leakage Circuit Breaker	M/C	Magnetic Contactor


### NOTES

1. This wiring diagram applies only to the Indoor unit.
2. Symbols show as follow :  
blk: black, red: red, blu: blue, wht: white, yel: yellow, brn: brown, sky: skyblue, grn: green
3. For connection wiring indoor-outdoor transmission F1-F2, indoor-wired remote controller transmission F3-F4.
4. ⚡ Protective earth(SCREW)

# 3. Tank integrated hydro unit

## 3-3. Electrical wiring diagram

### AE260RNWMGG/EU

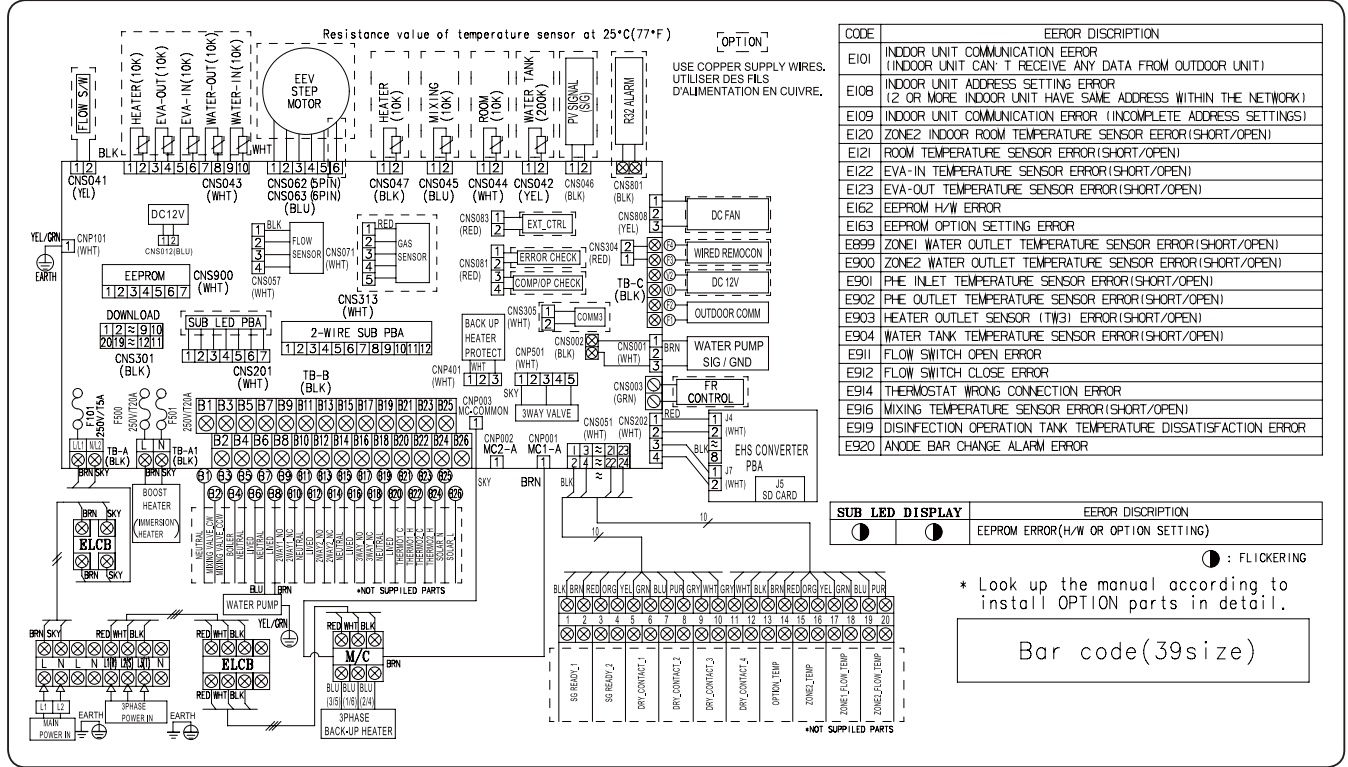

HEATER	Thermistor HEATER(10K)	EVA-OUT	Thermistor EVA-OUT(10K)
EVA-IN	Thermistor EVA-IN(10K)	WATER-OUT	Thermistor WATER-OUT(10K)
WATER-IN	Thermistor WATER-IN(10K)	WATER TANK	Thermistor WATER TANK(200K)
MIXING	Thermistor MIXING VALVE(10K)	WIRED REMOCON	Wired Remote Controller
OUTDOOR COMM	Outdoor Communication	SIG/GND	Signal/Ground
ELCB	Earth Leakage Circuit Breaker	M/C	Magnetic Contactor

### NOTES

1. This wiring diagram applies only to the Indoor unit.
2. Symbols show as follow :  
blk: black, red: red, blu: blue, wht: white, yel: yellow, brn: brown, sky: skyblue, grn: green
3. For connection wiring indoor-outdoor transmission F1-F2, indoor-wired remote controller transmission F3-F4.
4. ⚡ Protective earth(SCREW)

## 3. Tank integrated hydro unit

### 3-4. Sound data

Capacity (Liter)	Model	Sound Pressure dB(A) (Heating)	Sound Power dB(A) (Heating)
200	AE200RNWMEG/EU+AE050RXYDEG/EU	26	40
	AE200RNWMEG/EU+AE080RXYDEG/EU	26	40
	AE200RNWMEG/EU+AE120RXYDEG/EU	30	44
	AE200RNWMEG/EU+AE160RXYDEG/EU	30	44
260	AE260RNWMEG/EU+AE080RXYDEG/EU	26	40
	AE260RNWMEG/EU+AE120RXYDEG/EU	30	44
	AE260RNWMEG/EU+AE160RXYDEG/EU	30	44
	AE260RNWMGG/EU+AE080RXYDGG/EU	26	40
	AE260RNWMGG/EU+AE120RXYDGG/EU	30	44
	AE260RNWMGG/EU+AE160RXYDGG/EU	30	44

#### NOTE


- Specifications may be subject to change without prior notice.
- Sound Pressure Level
  - Sound pressure level is obtained in an anechoic room.
  - Sound pressure level is a relative value, depending on the distance and acoustic environment.
  - Sound pressure level may differ depending on operation condition.
  - dBA = A-weighted sound pressure level
  - Reference acoustic pressure 0 dB = 20μPa
- Sound Power Level
  - Sound power level is an absolute value that a sound source generates.
  - dBA = A-weighted sound power level.
  - Reference power : 1pW.
  - Measured according to ISO 3741.

# 3. Tank integrated hydro unit

## 3-4. Sound data

### Sound Pressure level


Unit: dB(A)

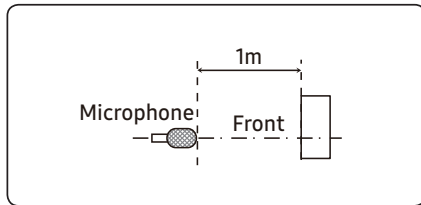


Model	Heating
AE200RNWMEG/EU+AE050RXYDEG/EU	26
AE200RNWMEG/EU+AE080RXYDEG/EU	26
AE200RNWMEG/EU+AE120RXYDEG/EU	30
AE200RNWMEG/EU+AE160RXYDEG/EU	30

- NR Curve


1) AE200RNWMEG/EU+AE050RXYDEG/EU

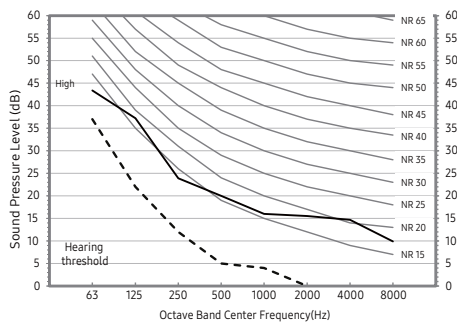


2) AE200RNWMEG/EU+AE080RXYDEG/EU

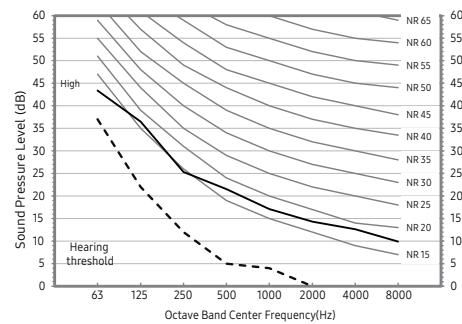

3) AE200RNWMEG/EU+AE120RXYDEG/EU

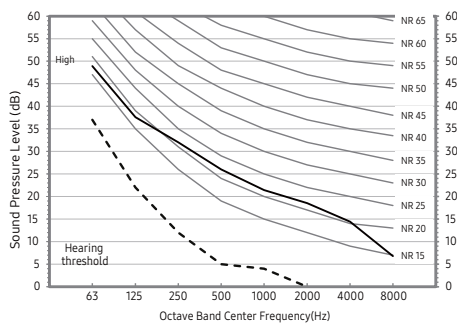

4) AE200RNWMEG/EU+AE160RXYDEG/EU

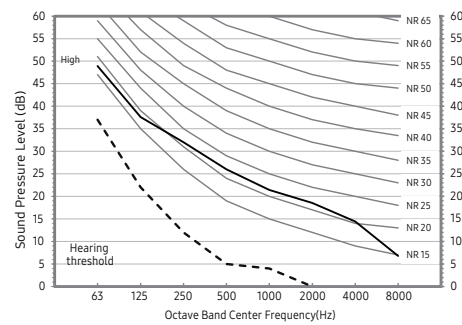

### NOTE


- Specifications may be subject to change without prior notice.
- Sound Pressure Level
  - Sound pressure level is obtained in an anechoic room.
  - Sound pressure level is a relative value, depending on the distance and acoustic environment.
  - Sound pressure level may differ depending on operation condition.
  - dBA = A weighted sound pressure level
  - Reference acoustic pressure 0 dB = 20μPa

# 3. Tank integrated hydro unit

## 3-4. Sound data

### Sound Pressure level


Unit: dB(A)

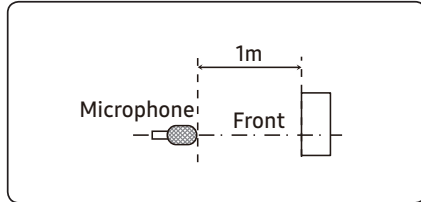


Model	Heating
AE260RNWMEG/EU+AE080RXYDEG/EU	26
AE260RNWMEG/EU+AE120RXYDEG/EU	30
AE260RNWMEG/EU+AE160RXYDEG/EU	30

- NR Curve


1) AE260RNWMEG/EU+AE080RXYDEG/EU

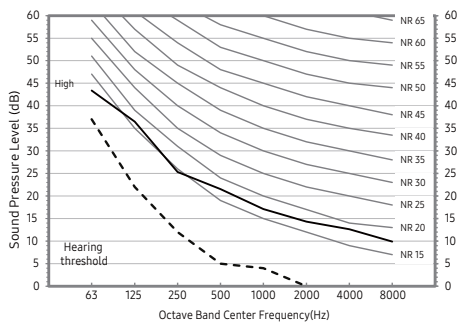

2) AE260RNWMEG/EU+AE120RXYDEG/EU

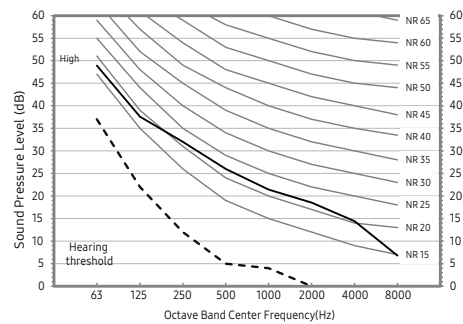

3) AE260RNWMEG/EU+AE160RXYDEG/EU

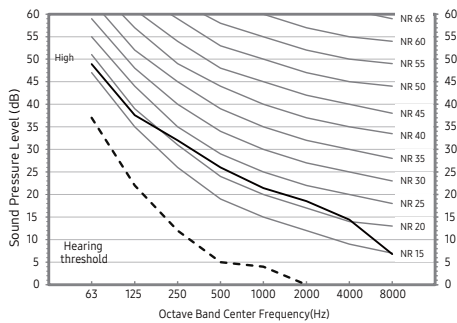

### NOTE


- Specifications may be subject to change without prior notice.
- Sound Pressure Level
  - Sound pressure level is obtained in an anechoic room.
  - Sound pressure level is a relative value, depending on the distance and acoustic environment.
  - Sound pressure level may differ depending on operation condition.
  - dBA = A weighted sound pressure level
  - Reference acoustic pressure 0 dB = 20μPa

# 3. Tank integrated hydro unit

## 3-4. Sound data

### Sound Pressure level


Unit: dB(A)

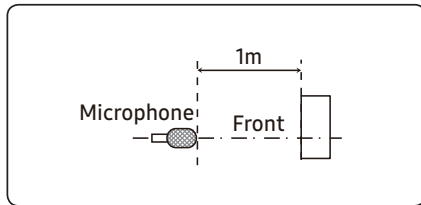


Model	Heating
AE260RNWMGG/EU+AE080RXYDGG/EU	26
AE260RNWMGG/EU+AE120RXYDGG/EU	30
AE260RNWMGG/EU+AE160RXYDGG/EU	30

- NR Curve


1) AE260RNWMGG/EU+AE080RXYDGG/EU

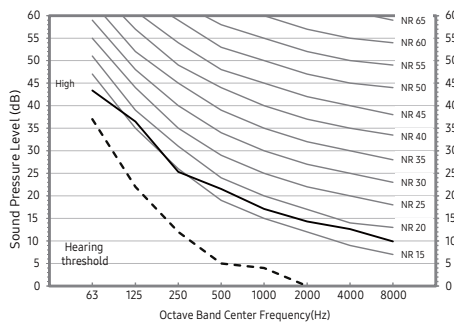

2) AE260RNWMGG/EU+AE120RXYDGG/EU

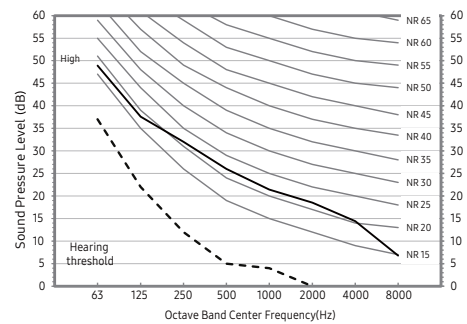

3) AE260RNWMGG/EU+AE160RXYDGG/EU

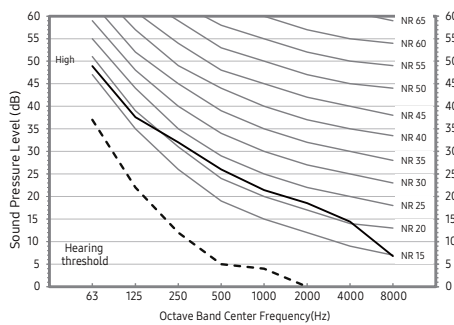

### NOTE

- Specifications may be subject to change without prior notice.
- Sound Pressure Level
  - Sound pressure level is obtained in an anechoic room.
  - Sound pressure level is a relative value, depending on the distance and acoustic environment.
  - Sound pressure level may differ depending on operation condition.
  - dBA = A weighted sound pressure level
  - Reference acoustic pressure 0 dB = 20μPa



# 3. Tank integrated hydro unit

## 3-4. Sound data


### Sound Power level

**NOTE**


- Specifications may be subject to change without prior notice
  - Sound power level is an absolute value that a sound source generates.
  - dBA = A-weighted sound power level.
  - Reference power : 1pW.
  - Measured according to ISO 3741.

Model	Power (dBA)
AE200RNWMEG/EU+AE050RXYDEG/EU	40
AE200RNWMEG/EU+AE080RXYDEG/EU	40
AE200RNWMEG/EU+AE120RXYDEG/EU	44
AE200RNWMEG/EU+AE160RXYDEG/EU	44


1) AE200RNWMEG/EU+AE050RXYDEG/EU

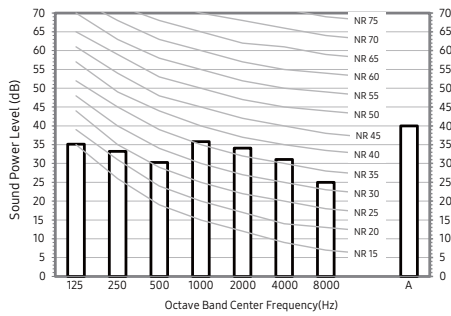


2) AE200RNWMEG/EU+AE080RXYDEG/EU

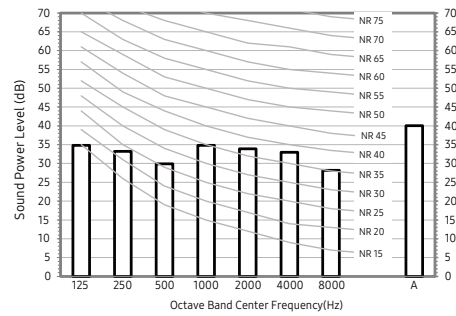

3) AE200RNWMEG/EU+AE120RXYDEG/EU

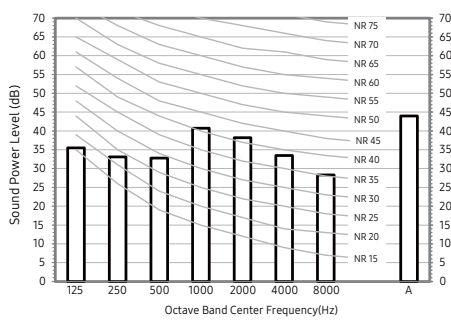

4) AE200RNWMEG/EU+AE160RXYDEG/EU

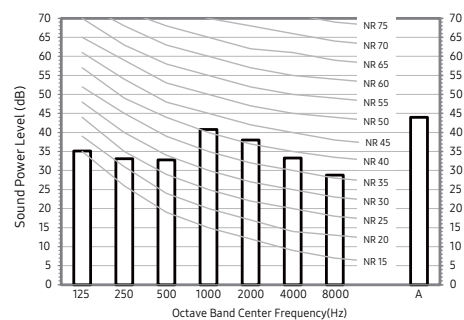

# 3. Tank integrated hydro unit

## 3-4. Sound data


### Sound Power level

**NOTE**


- Specifications may be subject to change without prior notice
  - Sound power level is an absolute value that a sound source generates.
  - dBA = A-weighted sound power level.
  - Reference power : 1pW.
  - Measured according to ISO 3741.

Model	Power (dBA)
AE260RNWMEG/EU+ AE080RXYDEG/EU	40
AE260RNWMEG/EU+ AE120RXYDEG/EU	44
AE260RNWMEG/EU+ AE160RXYDEG/EU	44


1) AE260RNWMEG/EU+AE080RXYDEG/EU

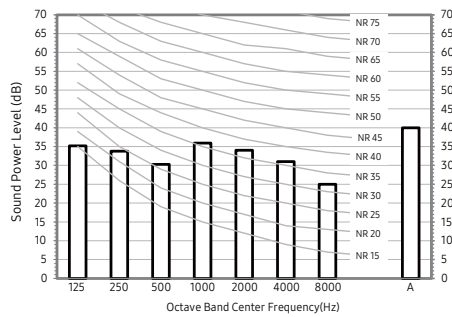

2) AE260RNWMEG/EU+AE120RXYDEG/EU

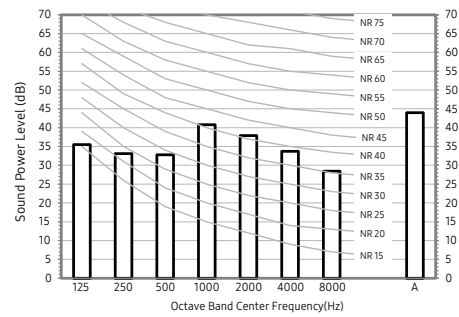

3) AE260RNWMEG/EU+AE160RXYDEG/EU

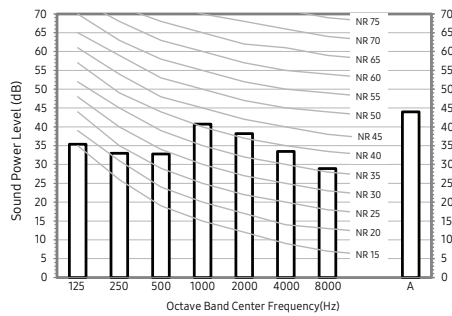

# 3. Tank integrated hydro unit

## 3-4. Sound data


### Sound Power level

#### NOTE


- Specifications may be subject to change without prior notice
  - Sound power level is an absolute value that a sound source generates.
  - dBA = A-weighted sound power level.
  - Reference power : 1pW.
  - Measured according to ISO 3741.

Model	Power (dBA)
AE260RNWMGG/EU+ AE080RXYDGG/EU	40
AE260RNWMGG/EU+ AE120RXYDGG/EU	44
AE260RNWMGG/EU+ AE160RXYDGG/EU	44


1) AE260RNWMGG/EU+AE080RXYDGG/EU

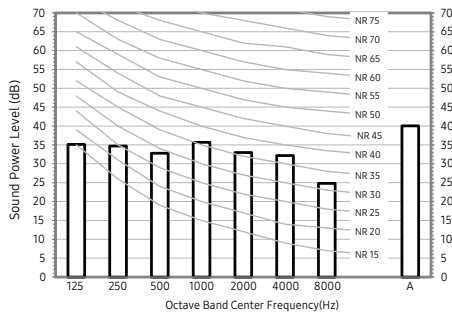

2) AE260RNWMGG/EU+AE120RXYDGG/EU

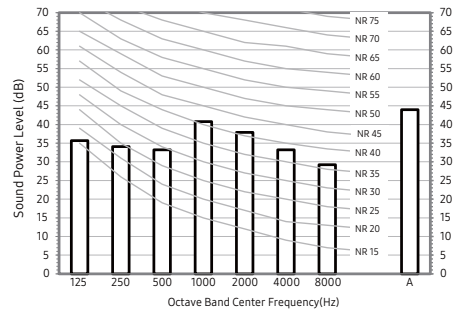


3) AE260RNWMGG/EU+AE160RXYDGG/EU

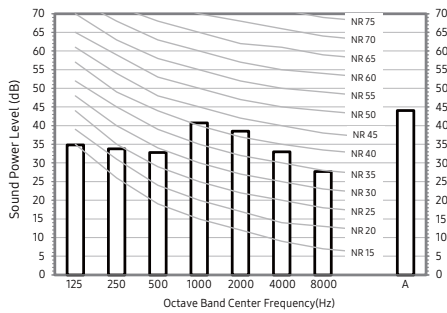

# 3. Tank integrated hydro unit

## 3-5. Piping diagram


AE200/260RNWS\*G/EU

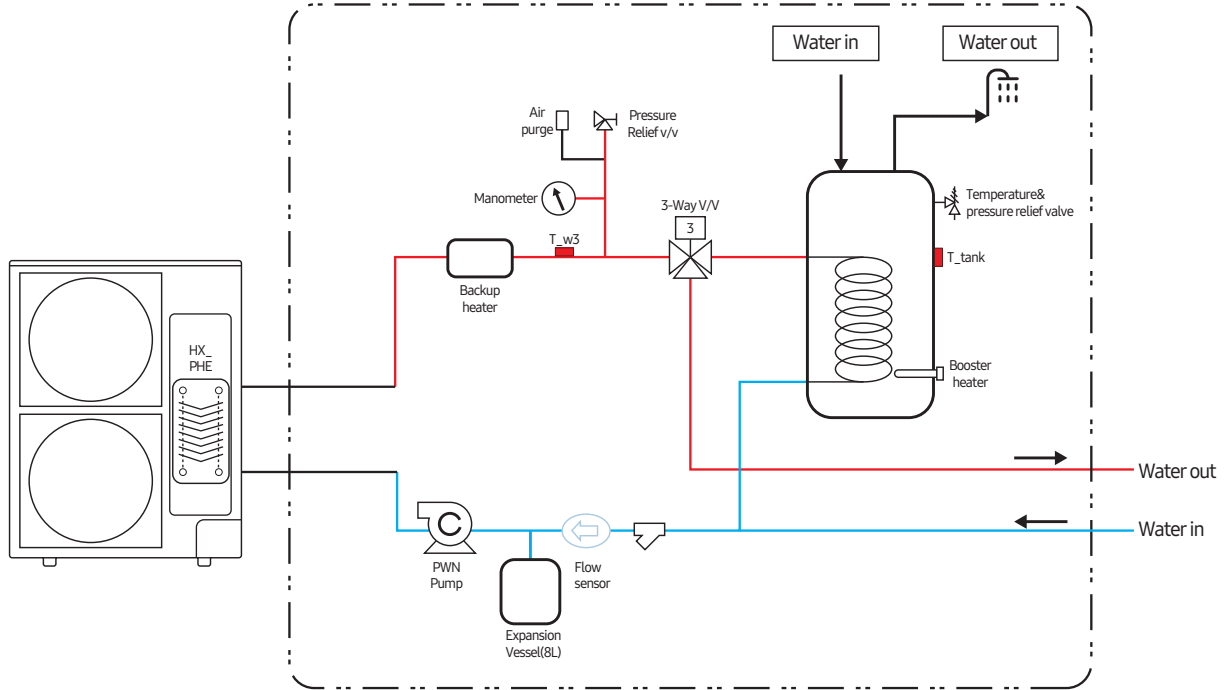

# 4. Installation

## Tank integrated hydro unit

### Mono outdoor + Tank Integrated Hydro Unit

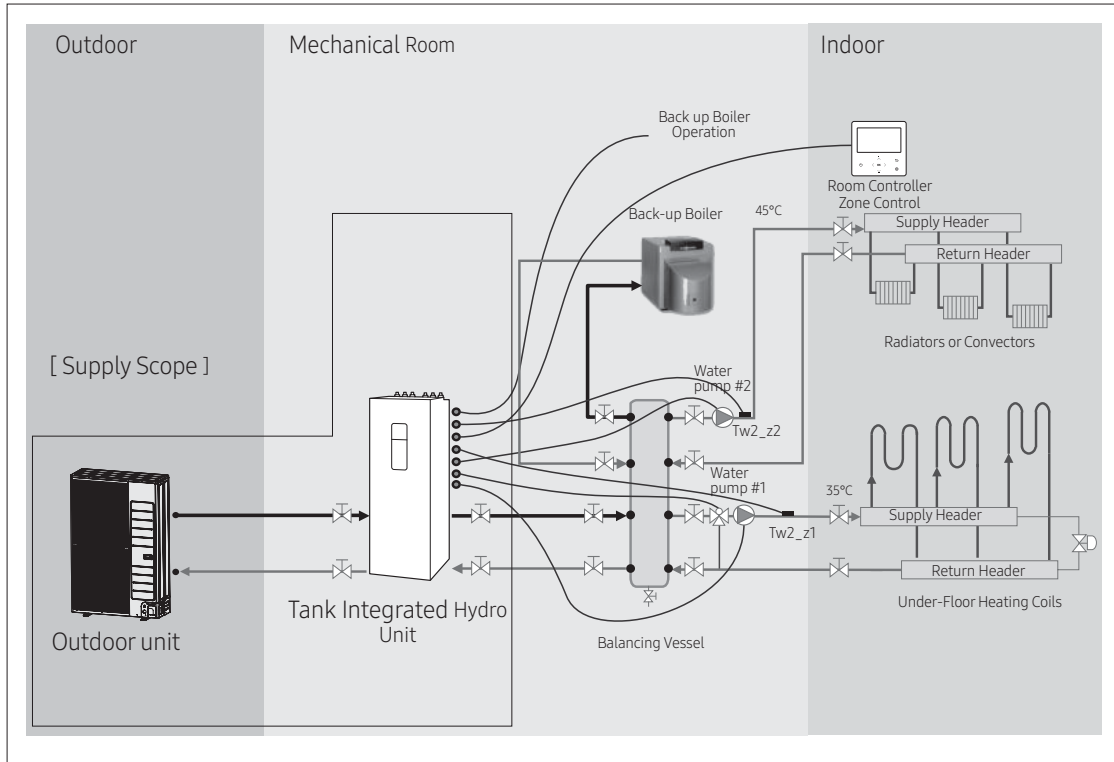


※ In case you want more information about the controllers and accessories, please refer to the Controller and Accessory TDB on [pvi.Samsung.com](http://pvi.Samsung.com) site or Global Partner Portal site.

# 4. Installation

## Tank integrated hydro unit

### Installation of mixing valve

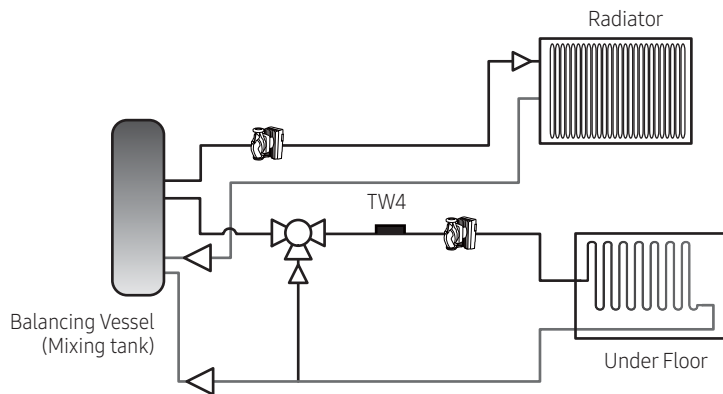

When two different zones are used with different temperature, adjust the temperature of discharge water to high temperature water and control the amount of bypass to provide low temperature water by applying the mixing valve and temperature sensor of the mixing valve (TW4).

1. Select a mixing valve from the manufacturers as below (recommended) and install it at the entrance of the zone.
2. Install the supplied temperature sensor (TW4) on the rear part of the mixing valve. Install TW4 Sensor within 1m of Mixing Valve.
3. Since running time varies depending on the manufacturer, set the FSV (default 90 sec.) by referring to the FSV value below.

Maker		BELIMO	SIEMENS	HONEYWELL
Model code	3 Way Valve	R3020-6P3-S2	VXP45.20-4 (kvs 4)	V5011E1213
	Actuator	LR230A(-S)	SSB31	ML6420A3015
Running time		90 sec.	150 sec.	60 sec.
FSV(#4046) setting		9	15	6

※ The table above is for your reference. It can be changed without advanced notice.

※ In case you want more information about the controllers and accessories, please refer to the Controller and Accessory TDB on [pvi.Samsung.com](http://pvi.Samsung.com) site or Global Partner Portal site.

# 4. Installation


## Tank integrated hydro unit

4. Set the FSV value by referring to the table below depending on installation environment.

Function	Details	Code	Unit	Default	Min.	Max.
Mixing valve	Use or not	4041	-	0(No)	0	2
	Target temperature difference (Heating) (TW3-TW4)	4042	°C	10	5	15
	Target temperature difference (Cooling) (TW4-TW3)	4043	°C	10	5	15
	Control factor	4044	-	2	1	5
	Interval of valve control	4045	Min.	2	1	30
	Running time (10 second unit)	4046	(x10) sec	9	6	24

- ※ 4041 =1 : Controlled based on the temperature difference (4042, 4043)
- ※ 4041 =2 : Controlled based on the temperature difference of the WL value

ex) Heating

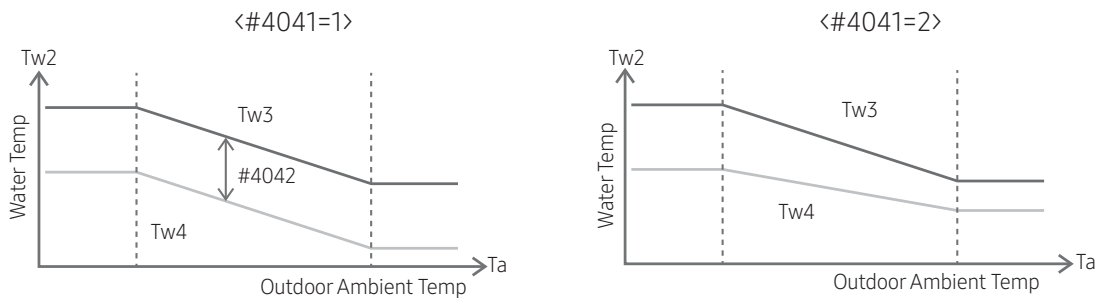

- ※ The mixing valve is controlled based on the FCU WL value.
- ※ As the #4044 value increases and the #4045 value decreases, the control speed increases. (Temperature hunting may occur if the control speed increases depending on the load.)
- ※ The additional pump and mixing valve should be purchased separately. TW4 sensor is included in the product accessories.
- ※ TW3 : Water temp. sensor 3

### CAUTION


- When the thermostat control is set as 'Use', the mixing valve can be used for Zone 1 and Zone 2. (When both FSV #2091 and #2092 are set as 1/2)
- When using Zone control (FSV 4061 = 1), ignore Thermostat signal.

※ In case you want more information about the controllers and accessories, please refer to the Controller and Accessory TDB on [pvi.Samsung.com](http://pvi.Samsung.com) site or Global Partner Portal site.

# 4. Installation

## Tank integrated hydro unit

### 2-zone control using Thermostat

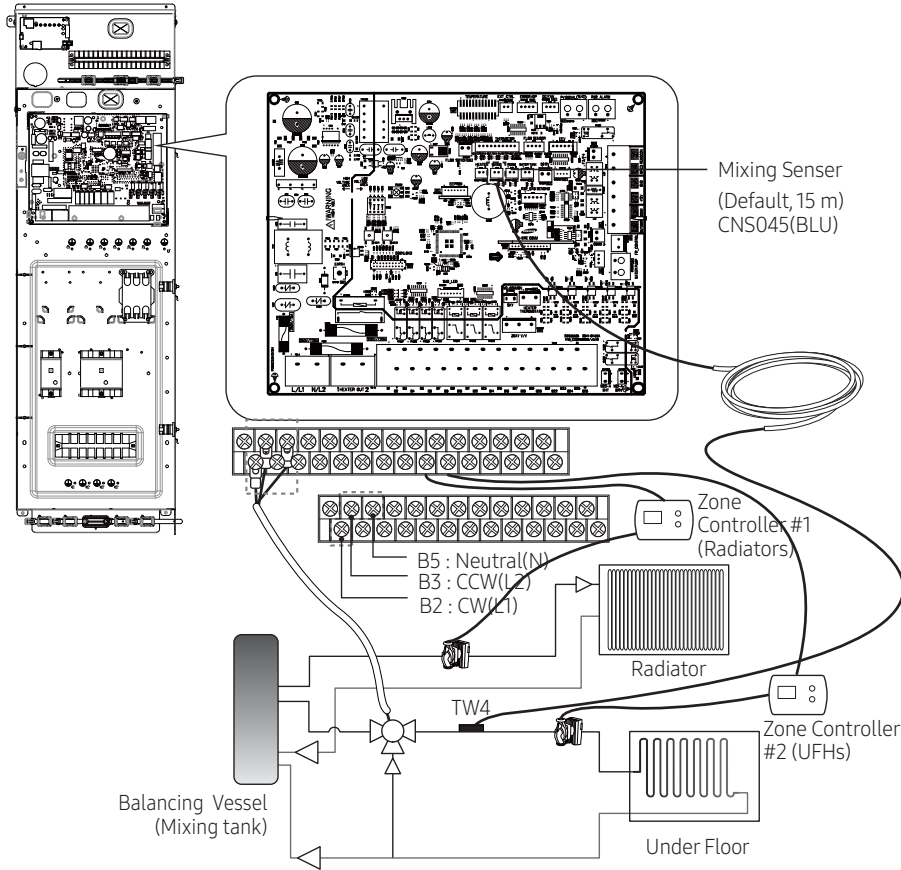

Description	No. of wires	Max. current	Thickness	Supply Scope
Mixing valve	4	22 mA	> 0.75 mm <sup>2</sup> , H05RN-F or H07RH-F	Field supply (230 V~, Input)

1. Before the installation, hydro unit should be turned off.
2. Using the appropriate equipment to correct position of terminal block as shown on the diagram.


※ In case you want more information about the controllers and accessories, please refer to the Controller and Accessory TDB on [pvi.Samsung.com](http://pvi.Samsung.com) site or Global Partner Portal site.



# 4. Installation

## Tank integrated hydro unit

### 2-Zone Control Using Remote Controller

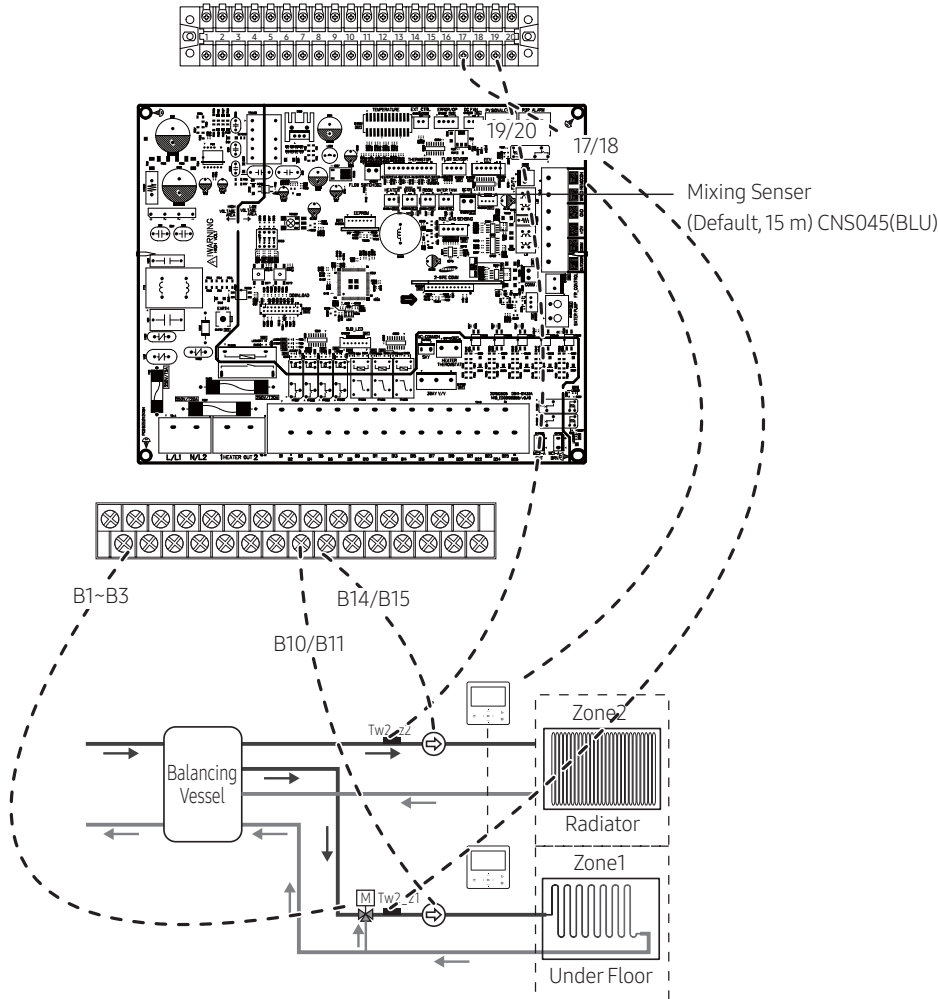

You can operate the 2-zone control using a mixing value, water-out temperature sensors, and built-in or external room temperature sensors installed in a wired remote controller.

When both zones are simultaneously Thermo on, the operation is performed based on Zone2. Therefore, set the zone that you want to have the higher set temperature to Zone2.

(The mixing valve must be installed in the zone that you want to have the lower set temperature.)


1. Install the mixing valve. (See "Installation of mixing valve.")
  2. Install the water-out temperature sensors (Tw2\_z1, Tw2\_z2) for all zones.
  3. Unlike the zone control with a thermostat, connect the water pump signal lines to the product.
    - Zone1 water pump connection: B10 (L1) + B11 (N)
    - Zone2 water pump connection: B14 (L1) + B15 (N)
  4. FSV 4061 = 1: Enable the 2-zone control using the wired remote controller.
- ※ If you want to operate the 2-zone control by using water-out temperatures, you have only to complete steps 1 to 4 above.
- ※ If you want to operate the 2-zone control by using room temperatures and built-in temperature sensors in wired remote controllers, you must install two wired remote controllers in each room. (If you use external room temperature sensors, you can control each room temperature with only one wired remote controller.)
- ※ In case you want more information about the controllers and accessories, please refer to the Controller and Accessory TDB on [pvi.Samsung.com](http://pvi.Samsung.com) site or Global Partner Portal site.

# 4. Installation


## Tank integrated hydro unit

### Wiring work


\* When you use inlet hole through the cabinet top positions for power/communication wires, please fix the wire by using mount tie of the cabinet right.

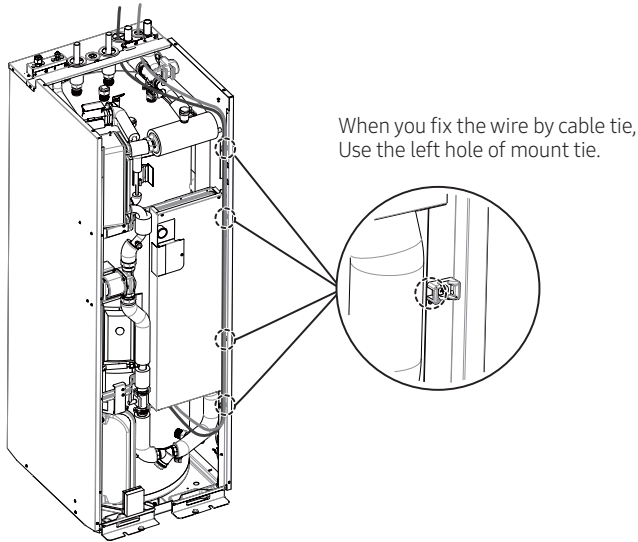

### 2 wires for communication cable

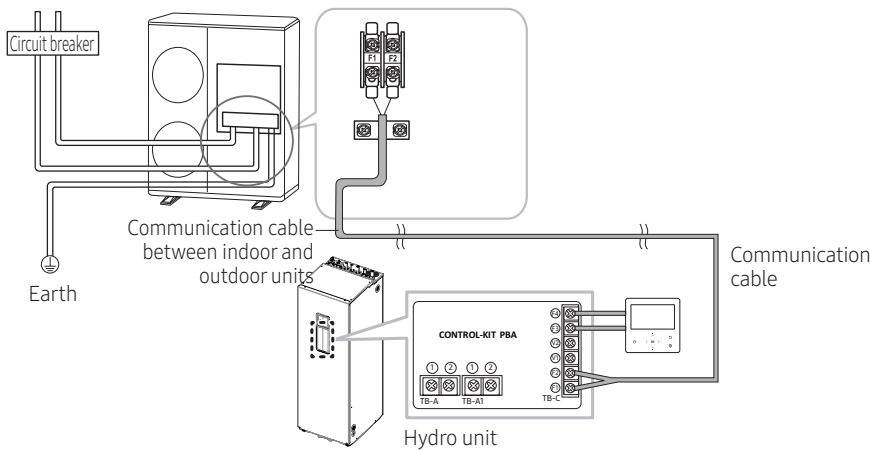

### Communication cable connection

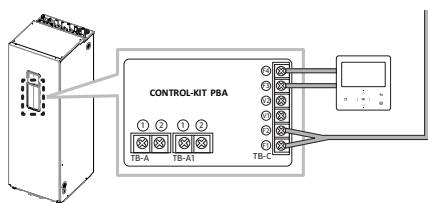


※ In case you want more information about the controllers and accessories, please refer to the Controller and Accessory TDB on [pvi.Samsung.com](http://pvi.Samsung.com) site or Global Partner Portal site.


# 4. Installation

## Tank integrated hydro unit

### 1. 1 phase product

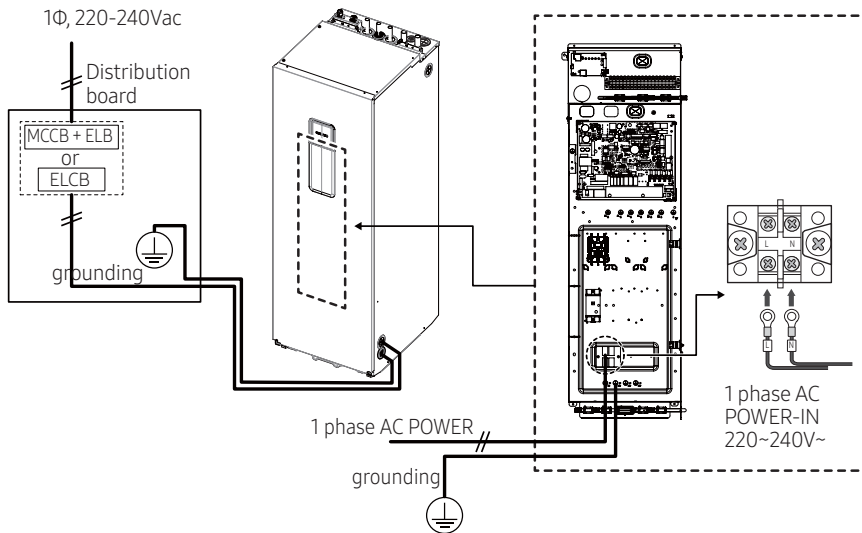

### 2. 3 phase product

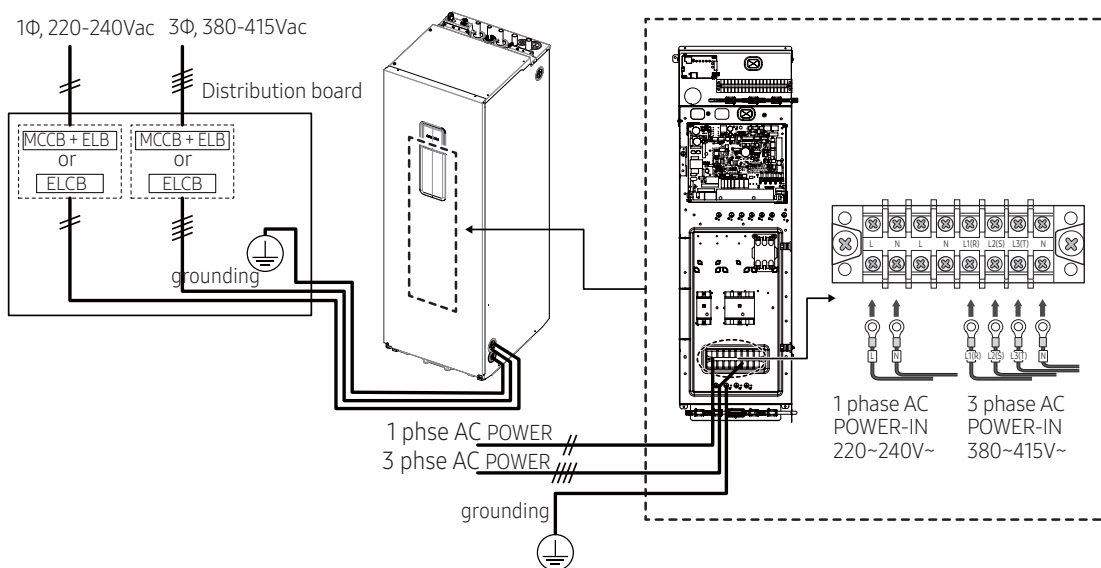

### ⚠ CAUTION

- If the supply cable is damaged, it must be replaced by a special cable or assembly available from the manufacturer or installer.
- Circuit Breaker (ELCB, ELB, MCCB etc.) for outdoor and indoor units shall be installed by installers because they are not sub-parts in the units. But you don't need to install for hydro unit (Built-in ELCB).
- It cause damage to chassis, PCB parts if the main power is not connected correctly. You should make certain that R, S, T is connected correctly before turning on the main power. (3 phase models only)

- ※ ELCB : Earth leakage circuit breaker
- ELB : Earth leakage breaker
- MCCB : Molded case circuit breaker

- ※ In case you want more information about the controllers and accessories, please refer to the Controller and Accessory TDB on [pvi.Samsung.com](http://pvi.Samsung.com) site or Global Partner Portal site.


# 4. Installation

## Outdoor Unit


### Space requirements for outdoor unit

#### When installing 1 outdoor unit


(Unit : mm)




※ When the air outlet is opposite the wall

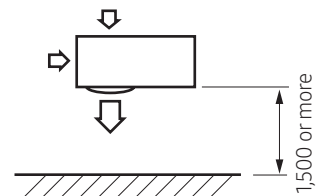


※ When the air outlet is towards the wall

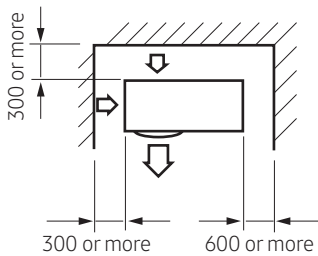


※ When 3 sides of the outdoor unit are blocked by the wall



※ The upper part of the outdoor unit and the air outlet is towards the wall



※ The upper part of the outdoor unit and the air outlet is opposite the wall

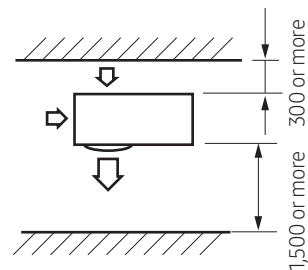

※ When front and rear side of the outdoor unit is towards the wall


※ In case you want more information about the controllers and accessories, please refer to the Controller and Accessory TDB on [pvi.Samsung.com](http://pvi.Samsung.com) site or Global Partner Portal site.

# 4. Installation


## Outdoor Unit

### When installing more than 1 outdoor unit


(Unit : mm)

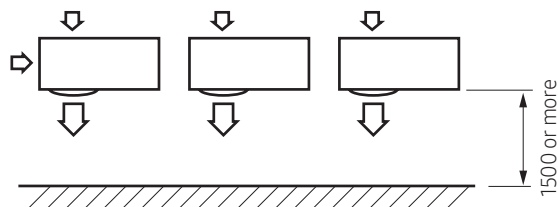


※ When the air outlet is towards the wall

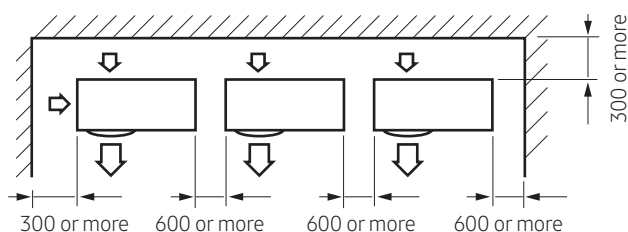


※ When 3 sides of the outdoor unit are blocked by the wall

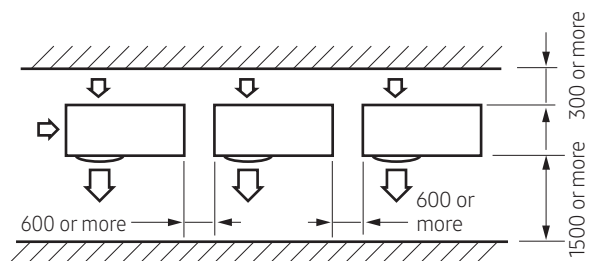

※ When front and rear side of the outdoor unit is towards the wall

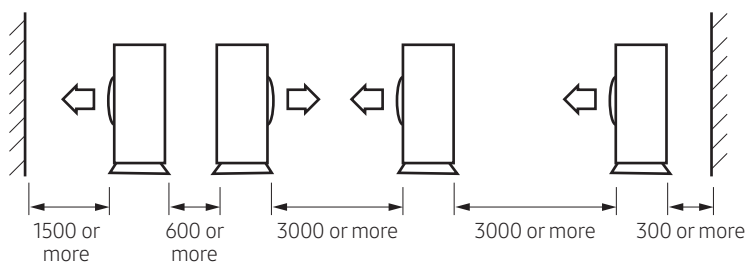

※ When front and rear side of the outdoor unit is towards the wall

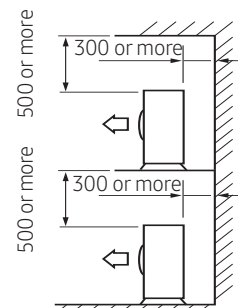

※ The upper part of the outdoor unit and the air outlet is opposite the wall

### ⚠ CAUTION

- The units must be installed according to distances declared, in order to permit accessibility from each side, either to guarantee correct operation of maintenance or repairing products. The unit's parts must be reachable and removable completely under safety condition (for people or things).

※ In case you want more information about the controllers and accessories, please refer to the Controller and Accessory TDB on [pvi.Samsung.com](http://pvi.Samsung.com) site or Global Partner Portal site.

# 4. Installation

## Outdoor Unit

### Outdoor unit installation

The outdoor unit must be installed on a rigid and stable base to avoid any increase in the noise level and vibration, particularly if the outdoor unit is to be installed in a location exposed to strong winds or at a height, the unit must be fixed to an appropriate support(wall or ground).



- Fix the outdoor unit with anchor bolts.

#### NOTE

- The anchor bolt must be 20mm or higher from the base surface.

#### CAUTION

- When tightening the anchor bolt, tighten the rubber washer to prevent the outdoor unit bolt connection part from corroding.
- Make a drain outlet around the base for outdoor unit drainage.
- If the outdoor unit is installed on the roof, you have to check the ceiling strength and waterproof the unit.

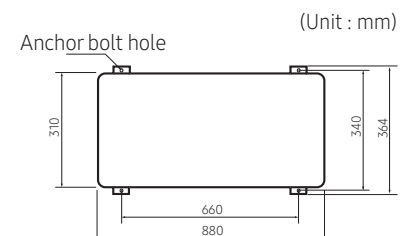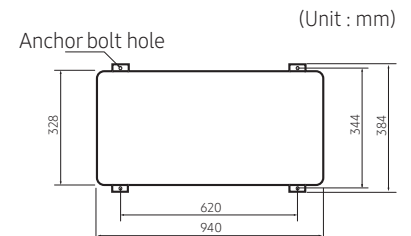

### Wiring

Two electronic cables must be connected to the outdoor unit.

- The connection cord between indoor unit and outdoor unit.
- The power cable between outdoor unit and auxiliary circuit breaker.
- Specially for Russian and European market, before installation, the supply authority should be consulted to determine the supply system impedance to ensure compliance.

#### CAUTION

- During the unit installation make first refrigerant connections and then electrical connections. If unit is uninstalled first disconnect electrical cables, then refrigerant connections.
- Connect the Air to water heat pump to grounding system before performing the electrical connection.
- When installing the unit, you shouldn't use inter connection wire.


※ In case you want more information about the controllers and accessories, please refer to the Controller and Accessory TDB on [pvi.Samsung.com](http://pvi.Samsung.com) site or Global Partner Portal site.

# 4. Installation

## Outdoor Unit

### Wiring diagram of power cable

#### When using ELB for 1 phase and 3 phase

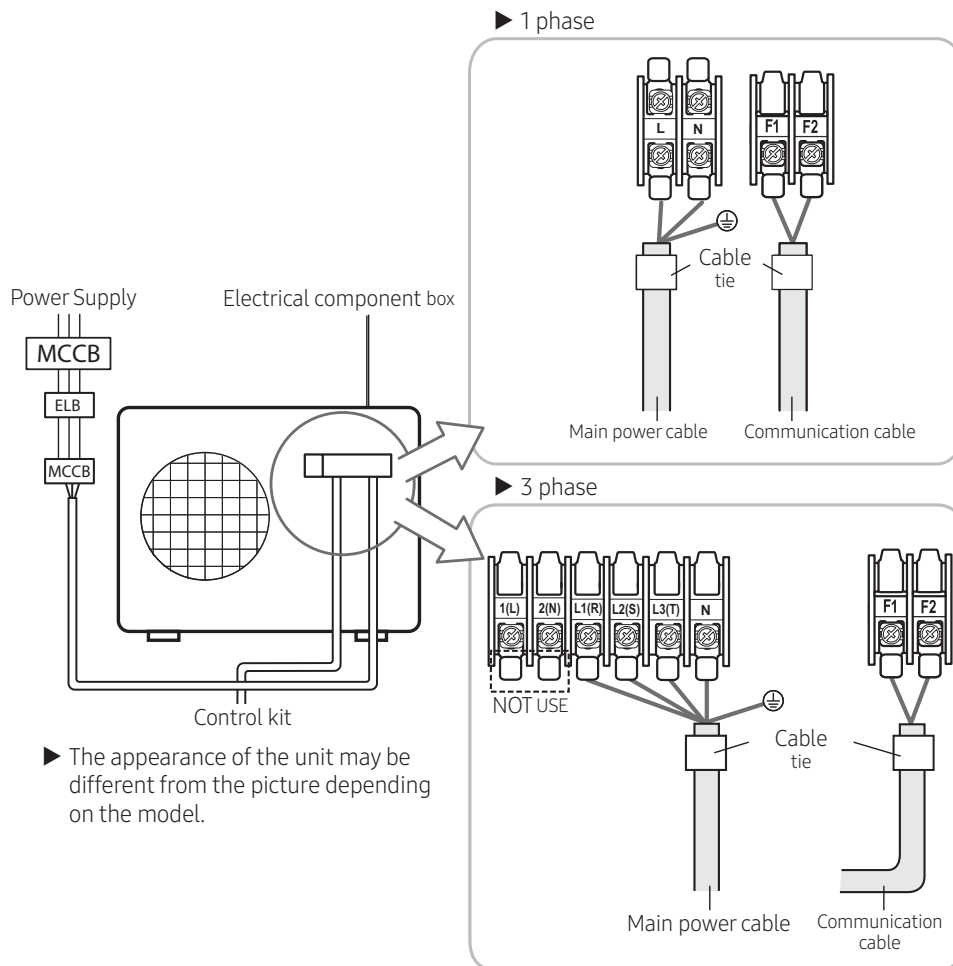

### ⚠ CAUTION

- You should connect the power cable into the power cable terminal and fasten it with a clamp.
- The unbalanced power must be maintained within 2% of supply rating.
  - If the power is unbalanced greatly, it may shorten the life of the condenser. If the unbalanced power is exceeded over 4% of supply rating, the control kit is protected, stopped and the error mode indicates.
- To protect the product from water and possible shock, you should keep the power cable and the connection cord of the control kit and outdoor units within ducts. (with appropriate IP rating and material selection for your application)
- Ensure that main supply connection is made through a switch that disconnects all poles, with contact gap of a least 3 mm.
- Devices disconnected from the power supply should be completely disconnected in the condition of overvoltage category.
- Keep distances of 50mm or more between power cable and communication cable.


※ In case you want more information about the controllers and accessories, please refer to the Controller and Accessory TDB on [pvi.Samsung.com](http://pvi.Samsung.com) site or Global Partner Portal site.

# 4. Installation


## Outdoor Unit

### Wiring diagram of connection cord

#### 1 phase

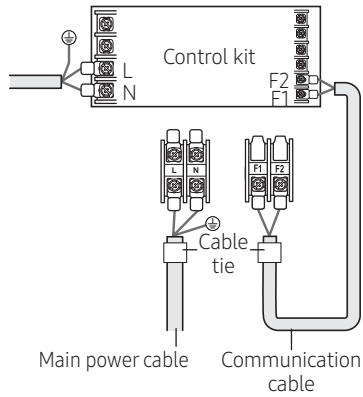

#### 3 phase

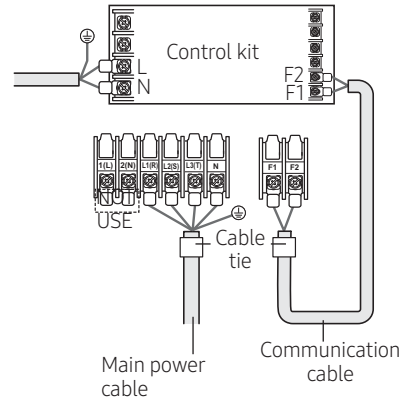

#### NOTE

- Lay the electrical wiring so that the front cover does not rise up when doing wiring work and attach the front cover securely.
- Ground wire for the indoor unit and outdoor unit connection cable must be clamped to a soft copper tin-plated eyelet terminal with screw hole (NOT SUPPLIED WITH UNIT ACCESSORIES).



※ In case you want more information about the controllers and accessories, please refer to the Controller and Accessory TDB on [pvi.Samsung.com](http://pvi.Samsung.com) site or Global Partner Portal site.



2019.11  
Ver.1.2

**Samsung Electronics Co., LTD.**

Head Office (Suwon Korea) 129, Samsung-Ro, Yeongtong-Gu, Suwon City, Gyeonggi-Do, Korea 16677  
Website : [www.samsung.com](http://www.samsung.com), <https://partnerhub.samsung.com> Email : [airconditioner@samsung.com](mailto:airconditioner@samsung.com)  
Images and data in this book may subject to change without prior notice.